

Balancing and Settlement Code

Code Subsidiary Document

Loss of Load Probability Calculation Statement

DRAFT

~~Version 1.0~~

Effective Date: ~~5 November 2015~~

LOSS OF LOAD PROBABILITY CALCULATION STATEMENT**relating to****THE METHODS USED TO CALCULATE LOSS OF LOAD PROBABILITY VALUES**

1. This statement refers to the Balancing and Settlement Code dated ~~5 November 2015~~ and, in particular, to the requirements for a Loss of Load Probability Calculation Statement in Section T 1.6A thereof.
2. This Statement, ~~Version 1.0~~, is effective from ~~5 November 2015~~.
3. The Authority has approved this Statement.

DRAFT

Intellectual Property Rights, Copyright and Disclaimer

The copyright and other intellectual property rights in this document are vested in ELEXON or appear with the consent of the copyright owner. These materials are made available for you for the purposes of your participation in the electricity industry. If you have an interest in the electricity industry, you may view, download, copy, distribute, modify, transmit, publish, sell or create derivative works (in whatever format) from this document or in other cases use for personal academic or other non-commercial purposes. All copyright and other proprietary notices contained in the document must be retained on any copy you make.

All other rights of the copyright owner not expressly dealt with above are reserved.

No representation, warranty or guarantee is made that the information in this document is accurate or complete. While care is taken in the collection and provision of this information, ELEXON Limited shall not be liable for any errors, omissions, misstatements or mistakes in any information or damages resulting from the use of this information or action taken in reliance on it.

CONTENTS

1.	Introduction	6
1.1	Scope and Purpose of the Statement	6
1.2	Balancing and Settlement Code Provision	6
1.3	Main Users of the Procedure and their Responsibilities	6
1.4	Use of the Procedure	6
1.5	Review Procedure for the LoLP Calculation Statement	7
1.6	Associated Code Subsidiary Documents	7
1.7	Abbreviations, Acronyms and Definitions	7
2.	Context	10
2.1	Definition of LoLP and Indicative LoLP	10
3.	Common calculation building blocks	11
3.1	Inputs	11
3.2	Modelling Conventional Generation Capacity (GCAP)	12
3.3	Modelling Availability Factors (AV)	13
3.4	Modelling Capacity Requirement (CR)	14
3.5	Modelling Wind (W)	16
3.6	Common lead times for publishing values	17
4.	Static Loss of Load Probability Function Method	18
4.1	Overview	18
4.2	Method for calculating static LoLP values from de-rated margin	18
4.3	Frequency of calculating and publishing Final LoLP values	18
4.4	Creation of Static LoLP function and lookup table	18
4.5	Review of Static LoLP function and look-up table	19
5.	De-rated Margin	20
5.1	Overview	20
5.2	Method for calculating De-rated Margin values	20
5.3	Frequency of calculating and publishing De-rated Margin values	21
6.	Dynamic Loss of Load Probability Function Method	22
6.1	Overview	22
6.2	Method for calculating dynamic LoLP values	22
6.3	Frequency of calculating and publishing Final and Indicative LoLP values	23
1.	Introduction	5
1.1	Scope and Purpose of the Statement	5

1.2	Balancing and Settlement Code Provision	5
1.3	Main Users of the Procedure and their Responsibilities	5
1.4	Use of the Procedure	5
1.5	Review Procedure for the LoLP Calculation Statement	6
1.6	Associated Code Subsidiary Documents	6
1.7	Abbreviations, Acronyms and Definitions	6
2.	Context	9
2.1	Definition of LoLP and Indicative LoLP	9
3.	Common calculation building blocks	10
3.1	Inputs	10
3.2	Modelling Conventional Generation Capacity (GCAP)	11
3.3	Modelling Availability Factors (AV)	12
3.4	Modelling Capacity Requirement (CR)	13
3.5	Modelling Wind (W)	15
3.6	Common lead times for publishing values	16
4.	Static Loss of Load Probability Function Method	17
4.1	Overview	17
4.2	Method for calculating static LoLP values from de-rated margin	17
4.3	Frequency of calculating and publishing Final LoLP values	17
4.4	Creation of Static LoLP function and lookup table	17
4.5	Review of Static LoLP function and look-up table	18
5.	De-rated Margin	19
5.1	Overview	19
5.2	Method for calculating De-rated Margin values	19
5.3	Frequency of calculating and publishing De-rated Margin values	20
6.	Dynamic Loss of Load Probability Function Method	21
6.1	Overview	21
6.2	Method for calculating dynamic LoLP values	21
6.3	Frequency of calculating and publishing Final and Indicative LoLP values	22

AMENDMENT RECORD

Version	Date	Description of Changes	Changes Included	Mods/ Panel/ Committee Refs
1.0	05/11/15	Approved version	P305	P244/11
<u>1.2</u>	<u>29/03/19</u>	<u>29 March 2019 Standalone Release</u>	<u>P369</u>	<u>TBC</u>

DRAFT

1. Introduction

[P369] The Balancing and Settlement Code uses Loss of Load Probability (LoLP) values in the calculation of Reserve Scarcity Prices. This Loss of Load Probability Calculation Statement (the Statement) explains how the National Electricity Transmission System Operator Transmission Company (NETSO) calculates Loss of Load Probability values.

1.1 Scope and Purpose of the Statement

In accordance with BSC Section T 1.6A, the BSC Panel (the Panel) is required to establish and maintain a Loss of Load Probability Calculation Statement.

This Statement sets the method for calculating LoLP values pursuant to the Static LoLP Function Method ('the Static Method') and the Dynamic LoLP Function Method ('the Dynamic Method') and the method for calculating a Static LoLP Function.

This Statement includes:

- (a) the constant parameters to be used in the determination of LoLP;
- (b) where applicable, the range of values used to determine LoLP values and functions; and
- (c) the processes to follow for reviewing, updating and publishing parameters that are to be performed by the Transmission Company NETSO on a regular basis.

1.2 Balancing and Settlement Code Provision

Interested parties should read this Statement in conjunction with the BSC and in particular Sections Q and T. The Panel established this Statement in accordance with the provisions of BSC Section T 1.6A. In the event of an inconsistency between the provisions of this Statement and the BSC, the provisions of the BSC shall prevail.

1.3 Main Users of the Procedure and their Responsibilities

[P369] The main users of this Statement are:

- The Transmission Company NETSO
- Generators
- Suppliers
- Non-physical traders

1.4 Use of the Procedure

The remaining sections in this document are:

Section 2 – 'Context'

Section 3 – 'Common calculation building blocks'

Section 4 – ‘Static Loss of Load Probability’

Section 5 – ‘De-rated margin’

Section 6 – ‘Dynamic Loss of Load Probability’

1.5 Review Procedure for the LoLP Calculation Statement

[P369] The Panel may review this Statement from time to time and make changes, subject to the Authority’s approval in accordance with BSC Section T 1.6A.3, 1.6A.4 and 1.6A.5.

The Panel will determine how it intends to review the Statement. Any review of the Statement must include consultation of Parties and other interested parties. The Panel must consider any representations made during the consultation and provide copies of any written representations to the Authority.

Where the Authority approves a revised LoLP Calculation Statement:

- (a) such revised Statement shall be effective from such date as the Panel shall determine with the approval of the Authority (and shall apply in respect of Settlement Days from that date); and
- (b) the Panel Secretary shall give notice of such date to the ~~Transmission Company~~ NETSO and each Party.

1.6 Associated Code Subsidiary Documents

BSCP01 ‘Overview of Trading Arrangements’

‘Imbalance Pricing’ Guidance Note

‘Balancing Mechanism Reporting Agent’ User Requirements Specification

‘Settlement Administration Agent’ User Requirements Specification

1.7 Abbreviations, Acronyms and Definitions

The following is a list of abbreviations and acronyms used in this LoLP Calculation Statement:

[369] Table 1 - List of abbreviations and acronyms

AV	Availability Factors
BM	Balancing Mechanism
BMRA	Balancing Mechanism Reporting Agent
BMRS	Balancing Mechanism Reporting Service
CCGT	Combined Cycle Gas Turbine
CR	Capacity Requirement

DRM	De-rated Margin
DSBR	Demand Side Balancing Reserve
FT	Per fuel type
GCAP	Conventional Generation Capacity
i	Per BMU
j	Per Settlement Period
LLR	Largest Loss Reserve
LoLP	Loss of Load Probability
LT	Lead Time
MW	Megawatt
<u>NETSO</u>	<u>National Electricity Transmission System Operator as the holder of the Transmission Licence and any reference to "NETSO", "NGESO", "National Grid Company" or "NGC" in the Code or any Subsidiary Document shall have the same meaning.</u>
OCGT	Open Cycle Gas Turbine
RRF	Response Remaining Factor
RSP	Reserve Scarcity Price
RT	Real Time
SAA	Settlement Administration Agent
SBR	Supplemental Balancing Reserve
STOR	Short Term Operating Reserve
STX	Station Load
URRM	Upward Response Reserve Multiplier
VoLL	Value of Lost Load

Table 2 - List of subscripts and superscripts

FT	Per fuel type
i	Per BMU
j	Per Settlement Period
RT	Real Time

“Capacity Requirement”	The capacity (in MW) that consumers and other demand-side participants are expected to export from the Transmission System in a given Settlement Period.
“Conventional Generation Capacity”	The capacity (in MW) that conventional generators connected to the Transmission System are expected to deliver to the system in a given Settlement Period. Conventional generators are those that are connected to the Transmission System and that rely on non-renewable energy sources.
“Operational Day”	The period from 0500 hours on one day to 0500 on the following day
”Reserve Scarcity Price” (RSP)	In respect of a Settlement Period, the price determined in accordance with Section T3.13. The RSP is the product of the LoLP and VoLL It is a price that reflects the value of reserve when it is used based on the prevailing scarcity on the system
“Value of Lost Load” (VoLL)	Has the meaning given to it in Section T1.12.1. It is an administrative value that represents the price at which a consumer is theoretically indifferent between paying for their energy, and being disconnected..
“Transmission System”	means the system consisting (wholly or mainly) of high voltage electric lines owned or operated by transmission licensees within Great Britain, in the territorial sea adjacent to Great Britain and in any Renewable Energy Zone and used for the transmission of electricity
“Total Wind Generation Forecast”	Forecast of total output (in MW) expected from all wind generators connected to the Transmission System in a given hour, taking account of probability error
“BMRS Wind Generation Forecast”	Forecast of total output expected from all wind generators connected to the Transmission System in a given hour, as reported on the BMRS

Full definitions of the above acronyms are, where appropriate, included in the BSC or, where used, in this Statement.

2. Context

[P369] Approved BSC Modification P305 will re-price STOR Actions where the action's original utilisation price is less than the Reserve Scarcity Price (RSP) calculated for the corresponding Settlement Period. Reserve Scarcity Prices are the product of the Value of Lost Load (VoLL) and Final LoLP value.

P305 specified the use of two methods for calculating LoLP values – a Static LoLP Function Method and Dynamic LoLP Function Method. The ~~Transmission Company~~NETSO will use these methods at different times such that:

From 5 November 2015 the ~~Transmission Company~~NETSO will calculate Final LoLP values using the Static Method.

From 1 May 2018 the ~~Transmission Company~~NETSO will calculate Indicative LoLP values using the Dynamic Method, whilst it continues to calculate Final LoLP values using the Static Method.

From 1 November 2018 the ~~Transmission Company~~NETSO will calculate Indicative and Final LoLP values using the Dynamic Method.

This Statement describes the two methods for calculating LoLP values.

2.1 Definition of LoLP and Indicative LoLP

[P369] A LoLP value is a measure of scarcity in available surplus generation capacity that the ~~Transmission Company~~NETSO will calculate for each Settlement Period. That is, for a given level of Capacity Requirement (CR) (measured in MW) on the Transmission System the associated LoLP indicates the probability that there will be insufficient Total Generation Capacity (Z) (measured in MW) to meet the CR.

There are two types of LoLP values - indicative and final. For a given Settlement Period, the ~~Transmission Company~~NETSO produces Indicative LoLP values from data¹ it has available to it at defined lead times (at midday the day before and 8, 4 and 2 hours) ahead of Gate Closure for the Settlement Period. BSC Parties use Indicative LoLP values as an indication of the level of scarcity anticipated ahead of Gate Closure for a Settlement Period.

For the same Settlement Period, the ~~Transmission Company~~NETSO produces Final LoLP values from data available to it at Gate Closure. The Final LoLP is the best indication of expected scarcity during the Settlement Period.

The Balancing Mechanism Reporting Agent (BMRA) and Settlement Administration Agent (SAA) use Final LoLP values to produce Reserve Scarcity Prices.

¹ The ~~Transmission Company~~NETSO uses a variety of data sources to calculate LoLP values. The data used covers the operational features and expected operation of generating plant and the expected behaviour of consumers. These data items are referred to in the remainder of this Statement.

3. Common calculation building blocks

The calculation of Indicative and Final LoLP values using the static and dynamic methods rely on certain common elements – i.e. Conventional Generation Capacity (GCAP), Availability Factors (AV) for different generation fuel types, and Capacity Requirement (CR)).

This Section describes these common ‘building blocks’ in more detail.

3.1 Inputs

[P369] The ~~Transmission Company~~ NETSO uses the following data in the calculation of LoLP values, which it takes from the BM system².

Table 3 - Common inputs

Abbreviation/ Acronym/Term	Definition	Units/Range
BMU	Balancing Mechanism Unit	
FT	Fuel type – used by the BMU	Per BMU
PN	Physical Notification - the generation capacity expected to be exported by the BMU to the Transmission System during a Settlement Period	Per Settlement Period per BMU in MW
MEL	Maximum Export Limit – the maximum level at which the BM Unit may export to the Transmission System	Per Settlement Period per BMU in MW
MZT	Minimum Zero Time - is the minimum time that a BM Unit which has been exporting must operate at zero or be importing, before returning to exporting	Per Settlement Period per BMU in minutes
NDZ	Notice to Deviate from Zero – is the time required for a BM Unit to start importing or exporting energy, from a zero Physical Notification	Per Settlement Period per BMU in minutes
NDF + STX	National Demand Forecast + station load, also referred to as ‘Demand’	Per Settlement Period in MW
Demand + Interconnector Export	Transmission system demand forecast is made up of NDF+STX and the interconnector flow where exports are positive	Per Settlement Period in MW
NBM STOR	STOR provided by non BM units	Per Settlement Period in MW

² Except NBM STOR and $W_{\text{fest_mape}}$ which the ~~Transmission Company~~ NETSO publishes on the BMRS. The volume of NBM STOR available is in the range 0 -1500MW and $W_{\text{fest_mape}}$ has a value of 0.029667503.

Abbreviation/ Acronym/Term	Definition	Units/Range
W	Total Wind Generation Forecast for GB Transmission System	Per Settlement Period in MW
W_{fcst}	BMU Wind Generation Forecast	Per Settlement Period, Per BMU in MW
$W_{Capacity}$	Total wind capacity available in Settlement Period	Per Settlement Period in MW
W_{fcst_mape}	Mean absolute percentage error of historical W_{fcst} values	Static input value calculated from historical data

3.2 Modelling Conventional Generation Capacity (GCAP)

In order to calculate the Conventional Generation Forecast (X), Conventional Generation Capacity (GCAP_i) (i.e. excluding wind and other forms of renewable generation) is defined per BMU as follows:

$$GCAP_i = \begin{cases} MEL_i & FPN_i \neq 0 \\ MEL_i & NDZ_i < LT + 30 \text{ minutes AND unit desynchronised before } MZT_i \\ 0 & \text{otherwise} \end{cases}$$

Where:

MEL, FPN, NDZ and MZT are the averages across the Settlement Period from the latest submission per BMU

LT: Lead Time (minutes)

For a given Settlement Period, each BMU's GCAP is used in combination with a corresponding Availability Factor (see below) to calculate a Conventional Generation Forecast (X):

$$X_j = \sum(GCAP_{ij} \times AV_{ij})$$

3.2.1 Treatment of NDZ (i.e. Lead Time (LT) + 30 minutes)

When deriving the available capacity of a unit, the MEL is counted for all units that can be synchronised at any point within the relevant Settlement Period (hence the NDZ accounts for the lead time at the start of the period plus 30 minutes to the end).

3.2.2 Constraints

[P369] All MELs count towards GCAP_i and therefore the ~~Transmission Company~~ NETSO calculates LoLP regardless of whether generation is behind a constraint boundary and cannot

be accessed by the ~~Transmission Company~~NETSO. This is consistent with the method used by the ~~Transmission Company~~NETSO in the Capacity Mechanism.

3.2.3 Short Term Operating Reserve (STOR)

[P369] Whilst BM STOR is included in the calculation of GCAP, the ~~Transmission Company~~NETSO subtracts NBM STOR from the CR. This is because NBM STOR can consist of both generation output and demand reduction. Also, the ~~Transmission Company~~NETSO measures NBM STOR differently to BM STOR (i.e. NBM STOR units do not have MELs or NDZs). Ultimately NBM STOR will reduce overall demand and so the ~~Transmission Company~~NETSO subtracts it in the calculation of CR – see below.

3.2.4 Supplemental Balancing Reserve (SBR)

The calculation of GCAP excludes the MELs for any relevant Supplemental Balancing Reserve (SBR).

3.3 Modelling Availability Factors (AV)

[P369] When calculating a Conventional Generation Forecast, the ~~Transmission Company~~NETSO sets common generation Availability Factors (AV_{FT}) for different fuel types, so each BMU will have a corresponding AV_i depending on the BM Units main fuel source.

To calculate these common AV_{FT} factors, the ~~Transmission Company~~NETSO sums the minimum of MEL at Real Time and the forecast MEL at one hour ahead for each BMU that uses a particular fuel type. The ~~Transmission Company~~NETSO then divides the sum of minimum and forecast MELs by the total of the one hour ahead forecast MELs. This is to ensure that availability figures can never be greater than 1, as nuclear generators can ramp their MEL submissions to signal their availability. This has been calculated per fuel type and averaged across the whole year.

This availability average is calculated as follows:

$$AV_{FT} = \frac{\sum (\min(MEL_{RT_ft}, MEL_{x_ft}))}{\sum MEL_{x_ft}}$$

Where:

x = 1 hour ahead of real time forecasted MEL submission

For a given Settlement Period, each BMU's GCAP is used in combination with a corresponding Availability Factor (see below) to calculate a Conventional Generation Forecast (X):

$$X_j = \sum (GCAP_{ij} \times AV_{ij})$$

[P369] The ~~Transmission Company~~NETSO will use the Availability Factors set out in Table 4 from 5 November 2015³ are:

Table 4 - Fuel Type Availability Factors

Fuel type	Availability factors from forecast MEL
OIL	0.998
OCGT	0.997
NUCLEAR	0.998
HYDRO	0.988
PUMPED STORAGE	0.998
CCGT	0.989
COAL	0.986

The Availability Factors in Table 4 were calculated using data from January to December 2013. The ~~Transmission Company~~NETSO used data from 2013 to set this first set of Availability Factors as this data was used in the development of LoLP methods as part of Approved Modification P305's overall development.

The ~~Transmission Company~~NETSO will revise the factors each year with updated historical data at the same time as generating a new Static LoLP Function and lookup table (see Section 4.4). BSCCo will publish these revised factors alongside the lookup table on the ELEXON Portal.

In the instance of a new fuel type, there would be less than a year's worth of data required to calculate the availability of that fuel type. Therefore in these circumstances the ~~Transmission Company~~NETSO will determine an appropriate interim factor and notify BSCCo of its method. If this cannot happen then the ~~Transmission Company~~NETSO will take a weighted average of the availability factors to apply to the new fuel type.

3.4 Modelling Capacity Requirement (CR)

[P369] The Capacity Requirement (CR) for a given Settlement Period consists of system demand (Demand + Interconnector Export) plus the largest loss reserve (LLR) minus the volume of NBM STOR. This is calculated using:

$$CR = \text{Demand} + \text{Interconnector Export} + \text{LLR} - \text{NBM STOR}$$

Where:

$$\text{Demand} = \text{NDF} + \text{Station Load}$$

³ Until they are reviewed – as described in section 3.3.

Where:

NDF: this the ~~National Grid~~ NETSO National Demand Forecast (which includes system losses)

Station Load: the internal load of power stations required to supply the needs of their equipment.

Interconnector Export: this is the flow on the interconnector where exports are positive. Calculated by:

$$\text{Interconnector Export} = \sum_{k \in IC_s} (IC_FLOW_k)$$

$$IC_s = \{IFA, BRITNED, MOYLE, EAST_WEST\}$$

IC_FLOW = the sum of the interconnector flow with exports positive and aggregated per Settlement Period.

LLR: Largest Loss Reserve; this is the equation to determine the reserve the ~~Transmission Company~~ NETSO is required to hold to withstand the potential largest loss on the system (typically this largest loss is 1260MW for Sizewell B).

$$\text{LLR} = ((\text{Loss} - (\text{NDF} + \text{STX}) * 1\%) / \text{Response Remaining Factor}) / \text{Upward Response Reserve multiplier}$$

Where:

Response Remaining Factor: 0.68 [this is the amount of response remaining as some has been used already due to deviation in frequency from 50.0Hz and 49.9Hz]

Upward Response Reserve Multiplier (URRM): 0.55 [this models how much frequency response can be delivered from the available headroom]

Loss: 1260 MW is the value currently used as it is the typical largest loss that NG are holding response for.

NBM STOR: is the short term operating reserve available to the control room. As mentioned above in Section 3.2.3, the ~~Transmission Company~~ NETSO measures NBM STOR differently to BM STOR and because ultimately NBM STOR will reduce overall demand, the ~~Transmission Company~~ NETSO subtracts it in the calculation of CR – see above.

The calculation of CR does not take account of Demand Side Balancing Reserve (DSBR).

3.5 Modelling Wind (W)

[P369] In addition to determining a Conventional Generation Forecast (X), as described above, the ~~Transmission Company~~NETSO produces a Total Wind Generation Forecast (W) (measured in MW).

The Total Wind Generation Forecast is a forecast of all expected wind generation each hour. The ~~Transmission Company~~NETSO bases its Total Wind Generation Forecast (W) on the sum of individual BMU Wind Generation Forecasts (W_{fcst}) and a related forecast error (W_{fcst} error term).

The ~~Transmission Company~~NETSO calculates the Total Wind Generation Forecast (W) by first determining individual BMU Wind Generation Forecasts (W_{fcst}) using its own wind forecast system. The ~~Transmission Company~~NETSO's wind forecast system depends on the receipt of weather data and metered volumes from generation sites. The system processes the weather data every 6 hours to produce 48 hourly forecasts. The system blends the weather based forecasts with actual metered data to improve the accuracy of the forecasts. These individual BMU forecasts are summed together to produce a GB forecast.

The error distribution of Wind Generation Forecasts (W_{fcst} error term) more closely resembles a Laplace distribution than a normal distribution. Therefore the ~~Transmission Company~~NETSO determines the final Total Wind Generation Forecast (W) using a Laplace distribution with the location parameter equal to the median of relevant BMU Wind Generation Forecasts (W_{fcst}) and a scale parameter equal to the mean absolute percentage error of the sum of historical W_{fcst} values:

$$W_j \sim L(\text{location} = \text{median of } W_{fcst_{ij}} \text{ values, scale factor} = W_{fcst} \text{ error term})$$

Where:

W_j : is the Total Wind Generation forecast for a given Settlement Period (j)

$$W_{fcst} \text{ error term} = W_{fcst_mape} \times W_{capacity}$$

Where:

W_{fcst_mape} = is the mean absolute percentage error of the sum of all BMU Wind Generation Forecasts

$W_{capacity}$ = total national wind generation capacity

Whilst each Total Wind Generation Forecast covers an hour period, the same forecast is used for each Settlement Period that makes up that hour period.

The binomial distributions of X and Laplace distribution W can then be combined statistically, such that $Z = X + W$.

3.6 Common lead times for publishing values

[P369] For each Settlement Period, the ~~Transmission Company~~NETSO may be required to produce Indicative LoLP, Final LoLP and forecast De-rated Margin values at specific lead times ahead of the commencement of that Settlement Period.

These specific lead times are:

- (a) at 1200 hours on each calendar day the ~~Transmission Company~~NETSO shall send values applicable to all Settlement Periods for which Gate Closure has not yet passed occurring within the current Operational Day and the following Operational Day;
- (b) at 8 hours, 4 hours and 2 hours prior to the beginning of a Settlement Period the ~~Transmission Company~~NETSO shall send values applicable to that Settlement Period; and
- (c) at 1 hour prior to the beginning of a Settlement Period the ~~Transmission Company~~NETSO shall send a value applicable to that Settlement Period.

DRAFT

4. Static Loss of Load Probability Function Method

4.1 Overview

[P369] The Static LoLP Function Method (the ‘Static method’) of calculating LoLP values uses a pre-determined mathematical function (and lookup table) to convert a value of de-rated margin into a LoLP value. The ~~Transmission Company~~NETSO derives a mathematical function from the historical relationship between these two variables.

4.2 Method for calculating static LoLP values from de-rated margin

The Static method calculates Final LoLP values by using a forecast of de-rated margin (see Section 5), which the ~~Transmission Company~~NETSO converts to LoLP using a pre-determined Static LoLP Function and lookup table.

4.3 Frequency of calculating and publishing Final LoLP values

For each Settlement Period until 31 October 2018, the ~~Transmission Company~~NETSO will calculate and send to the BMRA a Final LoLP value in accordance with the Static Method at the specific lead time set out in 3.6(c) above – i.e. at Gate Closure.

If a Gate Closure forecast of de-rated margin is not available, the ~~Transmission Company~~NETSO will use the most recent forecast of de-rated margin instead. For example, the 2 hour ahead forecast or if that is not available the 4 hour ahead forecast, etc.

If no forecast of De-rated Margin is available, the ~~Transmission Company~~NETSO will report the Final LoLP value to the BMRA as ‘null’.

4.4 Creation of Static LoLP function and lookup table

The ~~Transmission Company~~NETSO generates a Static LoLP function by determining a relationship between historical values of LoLP and de-rated margin. This relationship is represented by using a normal cumulative density function to fit a smooth curve to the historical data. As a result this curve contains all the assumptions of the dynamic model (such as wind and demand forecast accuracy). At publication of this Statement, the Static function is defined as:

$$\text{LoLP} = 1 - \text{Normal cumulative density function}(\text{DRM}_j, \mu, \sigma^2)$$

Where:


DRM: is the De-rated Margin – see Section 5 below;

$\mu = 0$; and

$\sigma^2 = 700\text{MW}$

Based on this mathematical relationship, the ~~Transmission Company~~NETSO produces a lookup table that enables Parties to determine LoLP values based on a de-rated margin value. A copy of this lookup table is publicly available which Parties can find on the ELEXON Portal. The ~~Transmission Company~~NETSO and BSCCo will work together to ensure the

lookup table is maintained and contains up-to-date details, including any revisions to the definition of the Static function.

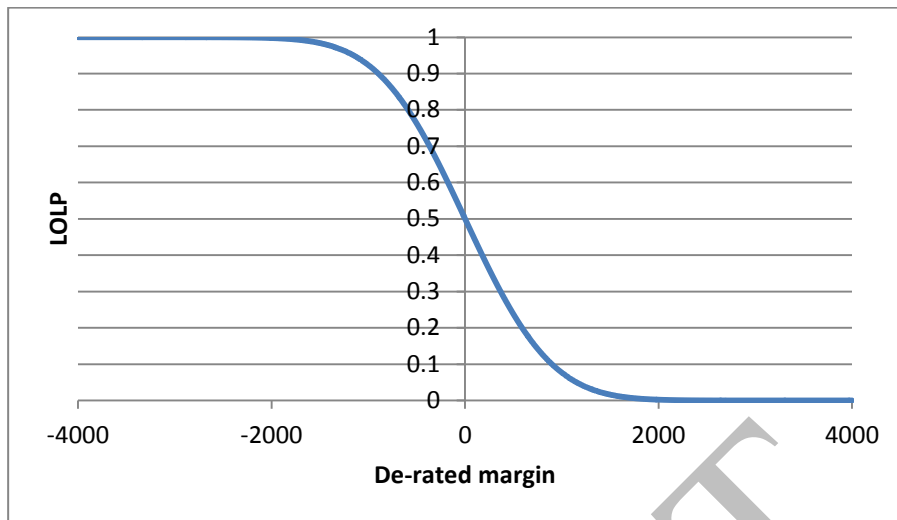

From the graph above it is clear that at 0MW of de-rated margin (note that at this point the only margin remaining is reserve for response which cannot be depleted) the LoLP value is 0.5. This is because when there is expected to be no de-rated margin available at Gate Closure there is statistically a 50:50 chance that there will be sufficient generation during the Settlement Period to meet demand i.e. because demand could reduce or generation increase or vice versa.

4.5 Review of Static LoLP function and look-up table

[P369] Until 1 November 2018, by the fifteenth working day of each December, the ~~Transmission Company~~ NETSO will produce and send to the BSCCo a revised Static function and lookup table.

To do this, the ~~Transmission Company~~ NETSO will record historical values of LoLP using its Dynamic Method (see Section 6) and de-rated margin (see Section 5), for the calendar year that has just passed. The ~~Transmission Company~~ NETSO will add this historical data to any existing historical data used to calculate Static LoLP Functions(s). The ~~Transmission Company~~ NETSO will use this enlarged data set to determine an updated relationship between LoLP and de-rated margin and generate an updated Static LoLP Function and lookup table.

Upon receipt from the ~~Transmission Company~~ NETSO, the BSCCo will publish the revised Static LoLP Function and lookup table on the ELEXON Portal by the end of the same December. This is to give BSC parties three months' notice before the revised function and lookup table take effect on 1 April each year.

5. De-rated Margin

5.1 Overview

[P369] The ~~Transmission Company~~ NETSO will produce values of de-rated margin at specific lead times ahead of a Settlement Period. The ~~Transmission Company~~ NETSO uses De-rated Margin values to calculate LoLP values in accordance with the Static LoLP Function Method – see Section 4.

5.2 Method for calculating De-rated Margin values

For a given Settlement Period, the ~~Transmission Company~~ NETSO will calculate the de-rated margin value by determining the Combined Generation Forecast and subtracting the Capacity Requirement (CR). This can be represented using:

$$\text{De-rated Margin (DRM}_j) = Z_j - \text{CR}_j$$

Where:

Z_j : is the Combined Generation Forecast (Z)

$$= X_j + U_j$$

Where:

X_j : is the Conventional Generation Forecast

$$= \sum(\text{GCAP}_{ij} \times \text{AV}_i)$$

GCAP_{ij} : is the Generation Capacity of a conventional generator – see 3.2

AV_i : is an Availability Factor – see 3.3

U_j : is the sum of BMU Wind Generation Forecasts for that Settlement Period as reported on BMRS - see 3.5 above

$$= \sum(W_{\text{fcst_ji}})$$

CR_j : is the Capacity Requirement – see 3.4

It should be noted that the calculation of De-rated Margin uses the sum of BMU Wind Generation Forecasts (U_j) rather than the Total Wind Generation Forecast (W_j) which is used for calculating a LoLP value using the Dynamic Method.

5.3 Frequency of calculating and publishing De-rated Margin values

[P369] For each Settlement Period, the ~~Transmission Company~~ NETSO will calculate and send to the BMRA forecast De-rated Margin values at specific lead times ahead of the Settlement Period commencing.

In particular, the ~~Transmission Company~~ NETSO will calculate De-rated Margin values in accordance with 3.6 (a), (b) and (c).

DRAFT

6. Dynamic Loss of Load Probability Function Method

6.1 Overview

[P369] The Dynamic LoLP Function Method (the ‘Dynamic method’) will be used by the ~~Transmission Company~~ **NETSO** to produce Indicative LoLP values from 1 May 2018 and Final LoLP values from 1 November 2018.

6.2 Method for calculating dynamic LoLP values

For a given Settlement Period, the dynamic model uses a direct relationship between the available generation (Z) and the Capacity Requirement (CR) and is defined as:

$$\text{LoLP}_j = P(Z_j - \text{CR}_j < 0)$$

Where:

Combined Generation Forecast (Z_j)

$$= X_j + W_j$$

Where:

X_j : is the Conventional Generation Forecast

$$= \sum (\text{GCAP}_{ij} \times \text{AV}_i)$$

GCAP_{ij} : is the Generation Capacity of a conventional generator – see 3.2

AV_i : is an Availability Factor – see 3.3

W_j : is the Total Wind Generation Forecast – see 3.5 above.

CR: is the Capacity Requirement

It should be noted that the calculation of a LoLP value using the Dynamic Method uses the the Total Wind Generation Forecast (W_j) rather than the sum of BMU Wind Generation Forecasts (U_j) which is used for calculating a De-rated Margin value.

6.3 Frequency of calculating and publishing Final and Indicative LoLP values

[P369] For each Settlement Period from 1 May 2018, the ~~Transmission Company~~NETSO will calculate and send to the BMRA Indicative LoLP values in accordance with the Dynamic method at the specific lead times set out in 3.6 (a) and (b) above.

For each Settlement Period from 1 November 2018, the ~~Transmission Company~~NETSO will calculate and send to the BMRA Final LoLP values in accordance with the Dynamic method at the specific lead time set out in 3.6 (c) above – i.e. at Gate Closure

If for whatever reason the ~~Transmission Company~~NETSO cannot produce an Indicative or Final LoLP value, it will report a ‘null’ value for that lead time. If no Indicative or Final LoLP value is received by the BMRA for a particular lead time, the BMRA will consider the value for that lead time to have been reported as ‘null’.

If the ~~Transmission Company~~NETSO reports a Final LoLP value as ‘null’ to the BMRA, the BMRA will use the most recent Indicative LoLP as the Final LoLP. For example, the 2 hour ahead Indicative LoLP or if that is not available the 4 hour ahead Indicative LoLP, etc.

DRAFT