

Use, review and feedback on the new Kinnect Insights Solution



System Prices Analysis Report: May 2022

Glossary

The System Prices Analysis Report (SPAR) provides a monthly update on price calculations. It is published by the ELEXON Market Operations on the Elexon Website and issued to the Imbalance Settlement Group (ISG) at their monthly meeting. This report provides data and analysis specific to System Prices and the Balancing Mechanism. It demonstrates the data used to derive the prices. The data is a combination of II and SF Settlement Runs.

On this page



Highlights from the May 2022 report

- ▶ Only five System Prices below £0/MWh all occurring on 18 May from Settlement Period 5 to 9.
- ▶ Coal and Battery Storage BMUs contributed the lowest monthly total of balancing action volume for their Fuel Types in 2022. This is likely due to lower demand for electricity in May.
- ▶ Only 17.6MWh of STOR volume utilised in May 2022, the lowest monthly total since August 2020 where no STOR actions were taken.

System Prices and length

This report covers the month of May. Where available, data uses the latest Settlement Run (in most cases 'II' or 'SF'). In this report, we distinguish between a 'long' and a 'short' market when analysing System Prices, because the price calculation differs between the two scenarios.

When the market is long, System Prices are based predominantly on the System Operator's 'sell' actions such as accepted Bids. When the market is short, System Prices are based predominantly on the System Operator's 'buy' actions.

System Prices summary by month (£/MWh)

COOKIES SETTINGS

This table gives a summary of System Prices for May, with values shown in £/MWh.

System Length

Long

Min	-69.49
Max	144.56
Median	74.00
Mean	70.25
Std.Dev	29.45

Short


Min	69.77
Max	354.75
Median	167.32
Mean	166.27
Std.Dev	43.40

Source: Elexon

Frequency of System Prices over last month

This graph shows the distribution of System Prices across Settlement Periods in May 2022 when the market was long and short. 80% of System Prices were between £45.72/MWh and £206.28/MWh regardless of system length. When the system was long, 80% of prices were


between £30.25/MWh and £105.00/MWh. When the system was short, 80% of prices were between £108.00/MWh and £220.00/MWh.

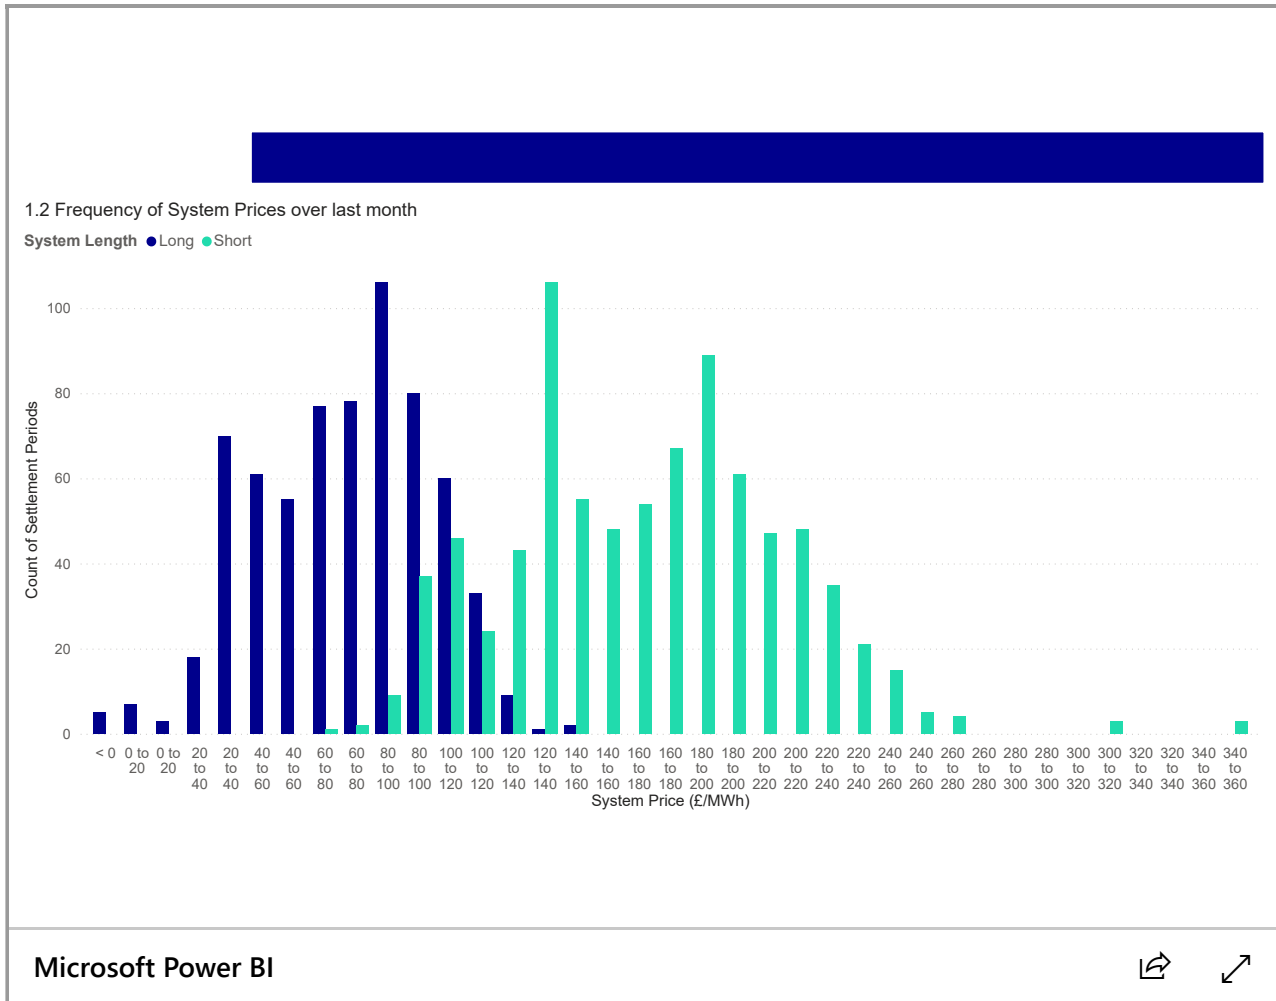

System Prices were £100.00/MWh or more on 879 occasions in May 2022. In the previous month there were 1,208 System Prices on or over £100.00/MWh. The highest System Price of the month, £354.75/MWh, occurred in Settlement Periods 34, 35 and 39 on 3 May. The price in all three Settlement Periods was set by Offers from a CCGT BMU priced at £345.00/MWh with a £9.75/MWh Buy Price Price Adjuster (BPA) applied.

The lowest System Price of -£69.49/MWh occurring in Settlement Periods 5, 6, 7, 8 and 9 on 18 May. These were the only five Settlement Periods to have a System Price less than £0.00/MWh in May 2022. The price in all five Settlement Periods was set by Bids from three Offshore Wind BMUs all priced at -69.49/MWh.

System Price spread The graph below displays the spread of System Prices in May 2022 as a box plot diagram, split between a short and long system.

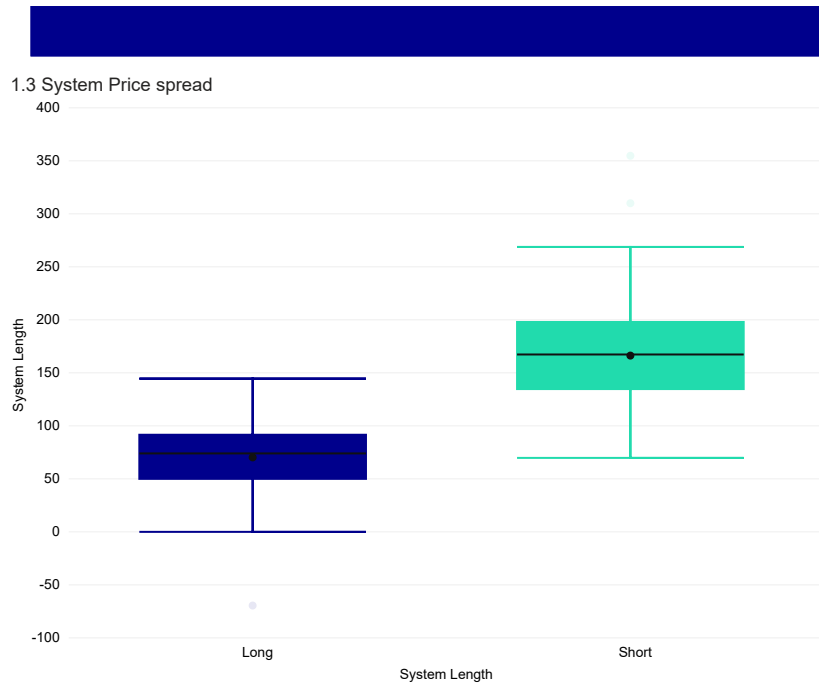

Microsoft Power BI



The middle line in each box represents the median System Price of the month, which is £167.32/MWh for short Settlement Periods and £74.00/MWh for long Settlement Periods. Each box edge represents the lower and upper quartiles (25th and 75th percentile respectively), with the Interquartile Range (difference between the Upper and Lower quartiles) being £63.31/MWh for short System Prices and £41.60/MWh for long System Prices.


Outliers are shown on the graph as circles, and have been defined as being greater than 1.5 times the Interquartile Range (IQR) away from the Upper and Lower quartiles. Under this definition, five long and six short System Prices in May were outliers. Of the five long outliers, all were less than the lower outlier boundary. The prices of Long outliers ranged from -£69.49/MWh (the lowest System Price of the month) to -£69.49/MWh. The highest System Price of the month, £354.75/MWh, was 2.12 times the median short System Price for the month.

Daily average System Price

The graph below shows daily average System Prices over the last month.

1.4 Daily average System Price

System Length ● Long ● Short

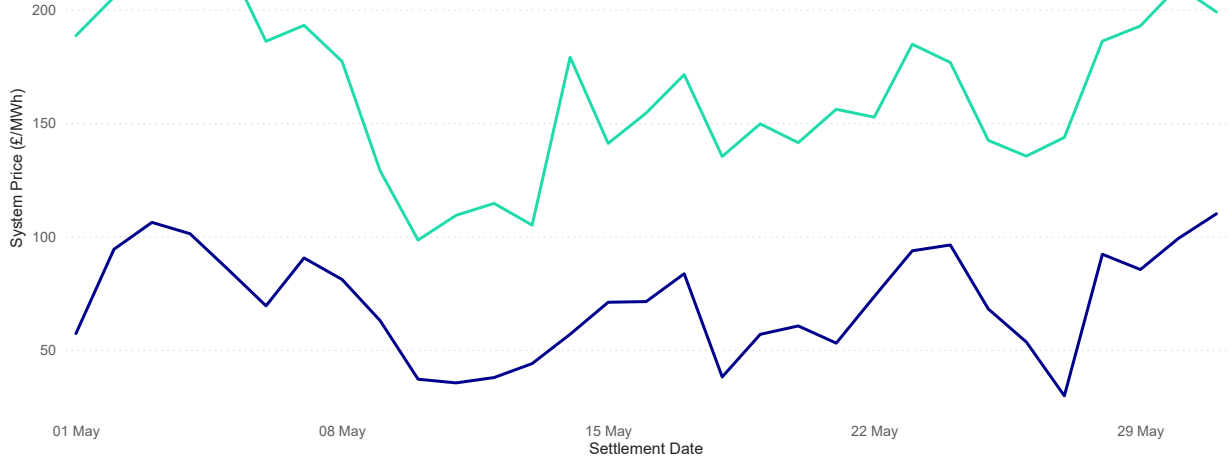

Microsoft Power BI




In May, the average System Price was £70.25/MWh when the system was long and £166.27/MWh when the system was short. The highest daily average price when the system was short was £227.25/MWh, and occurred on 3 May; the system was short for 35 Settlement Periods on this day. The lowest daily average price when the system was long was £29.79/MWh on 27 May. The system was long for 8 Settlement Periods on this day.

Average System Price by Settlement Period

The graph below shows the variation of average System Prices across the day.

1.5 Average System Price by Settlement Period

System Length ● Long ● Short

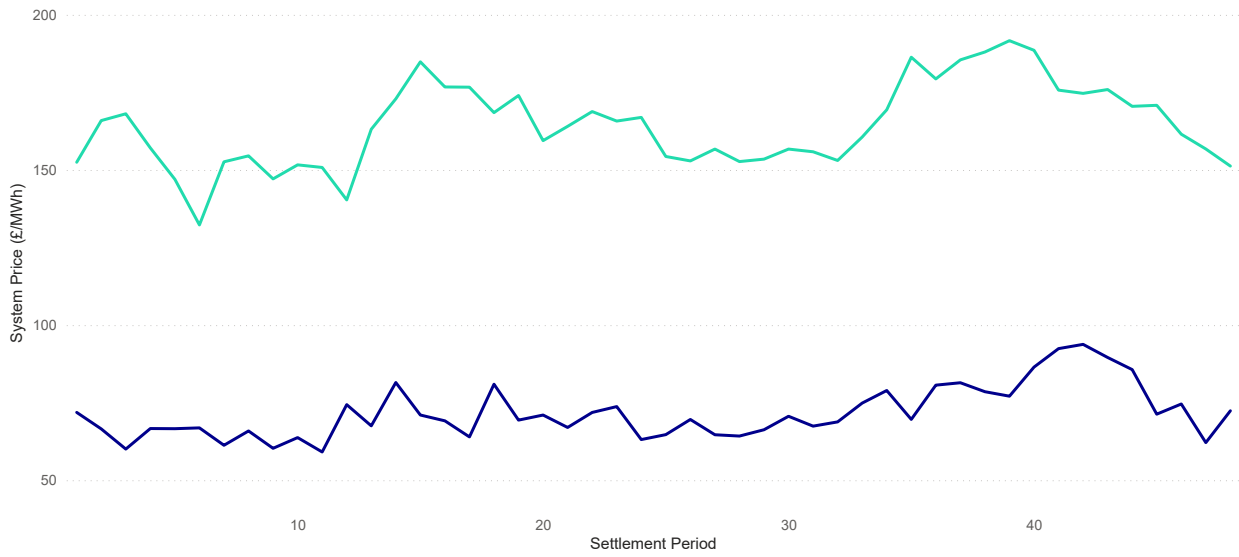

Microsoft Power BI




Short prices were highest in Settlement Period 39, with long prices lowest in Settlement Period 11. The lowest average System Price, regardless of market length, occurred during Settlement Period 6, when the System Price was £94.31/MWh. The daily average long Settlement Period System Prices ranged between £59.11/MWh and £93.79/MWh. Average short Settlement Period prices varied from £132.29/MWh to £191.69/MWh.

Daily System Length

This graph shows system length by day.

1.6 System Length by day

System Length ● Long ● Short

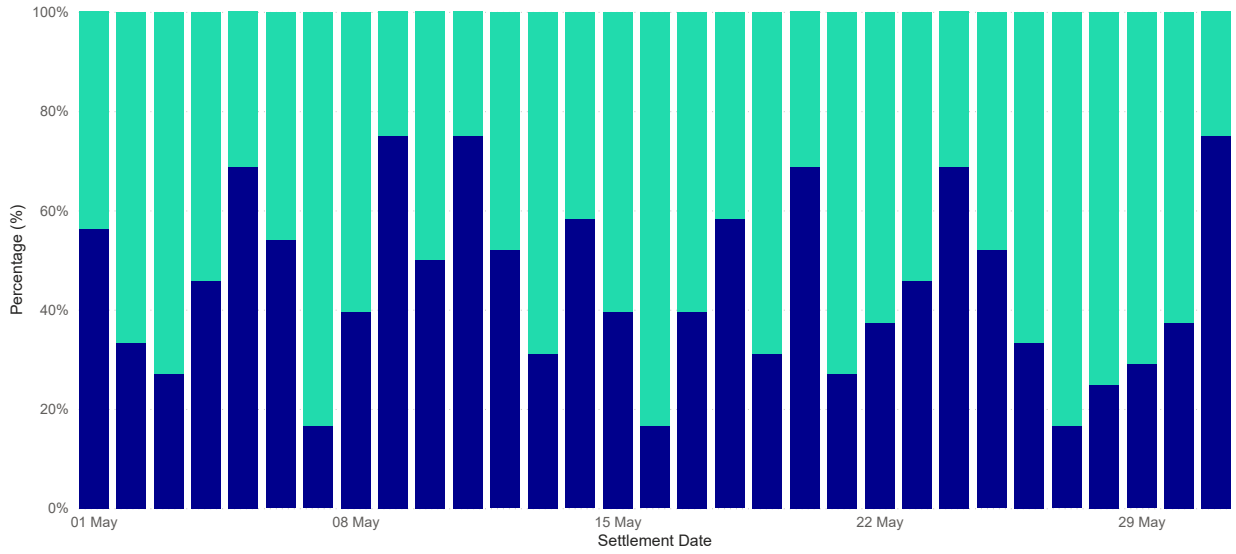

Microsoft Power BI




System Length by Settlement Period

This graph shows system length by Settlement Period for May.

1.7 System Length by Settlement Period

System Length ● Long ● Short

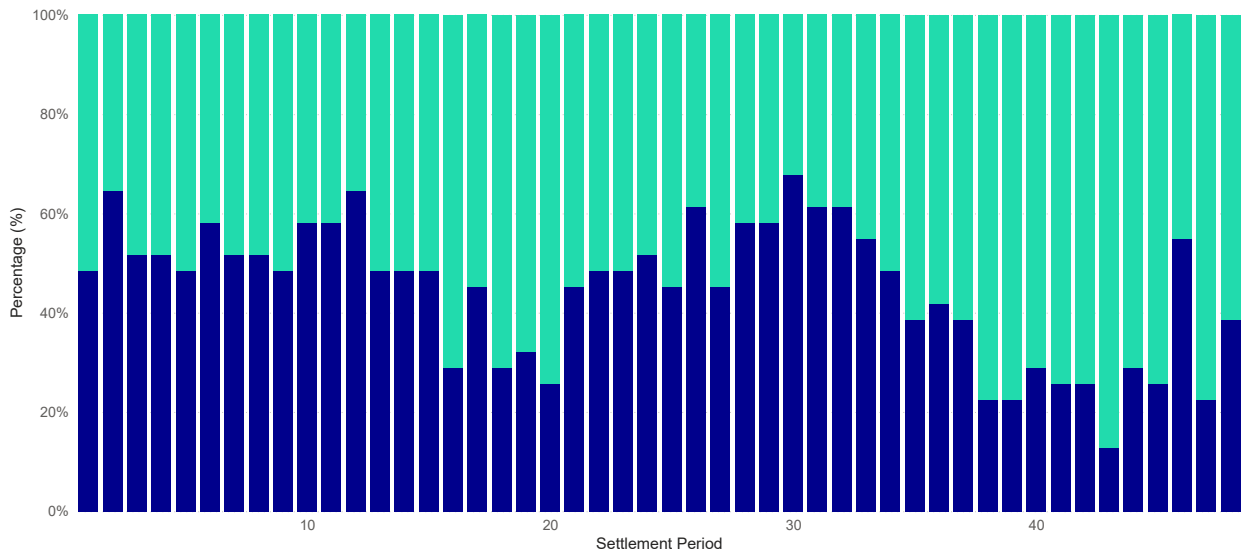

Microsoft Power BI



The system was long for 45% of Settlement Periods in May.

On 7 May, the system was short for 40 of 48 Settlement Periods. The long Settlement Periods on this day had an average NIV of -164MWh. The daily average NIV on this day was 178MWh.

Settlement Period 30 had the highest number of long Settlement Periods, with 68% of them being long this month.

Historic long vs short market


This graph shows the percentage of long and short Settlement Periods over the past year. May 2022 had 45% of long Settlement Periods, compared to 46% per month over the previous 12 months.

COOKIES SETTINGS



1.8 Historic Long vs Short Market

● Long ● Short

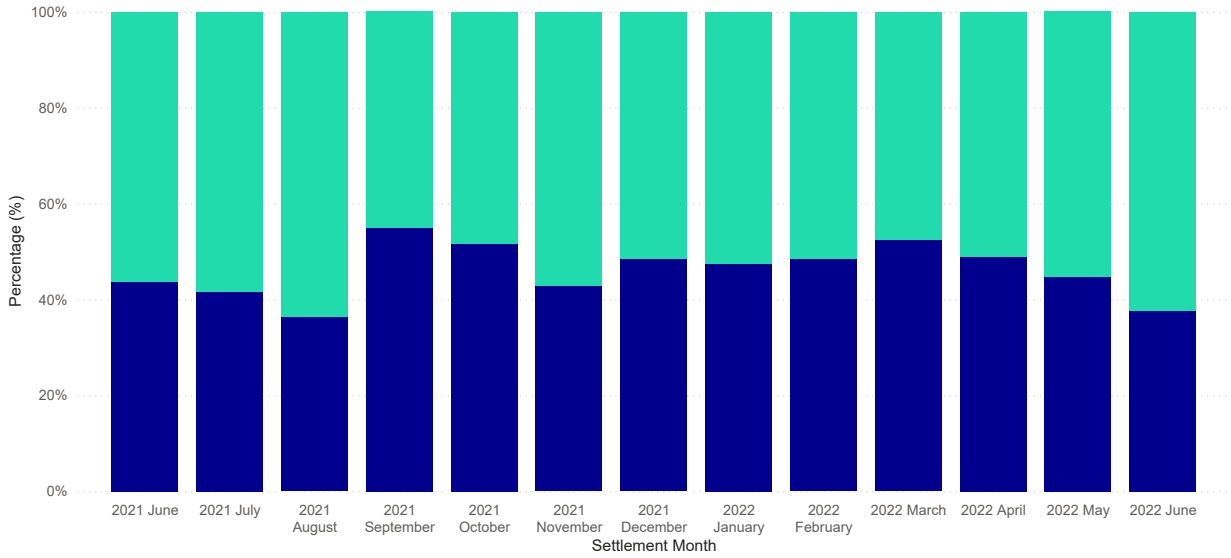

Microsoft Power BI




Average Daily System Price when Long by Settlement Day

The graph below displays the daily average System Prices in May 2022 when the system was long compared to the two previous months and the same month last year.

COOKIES SETTINGS

1.9 Average Daily System Price when Long by Settlement Day

Month ● Apr 22 ● Mar 22 ● May 21 ● May 22

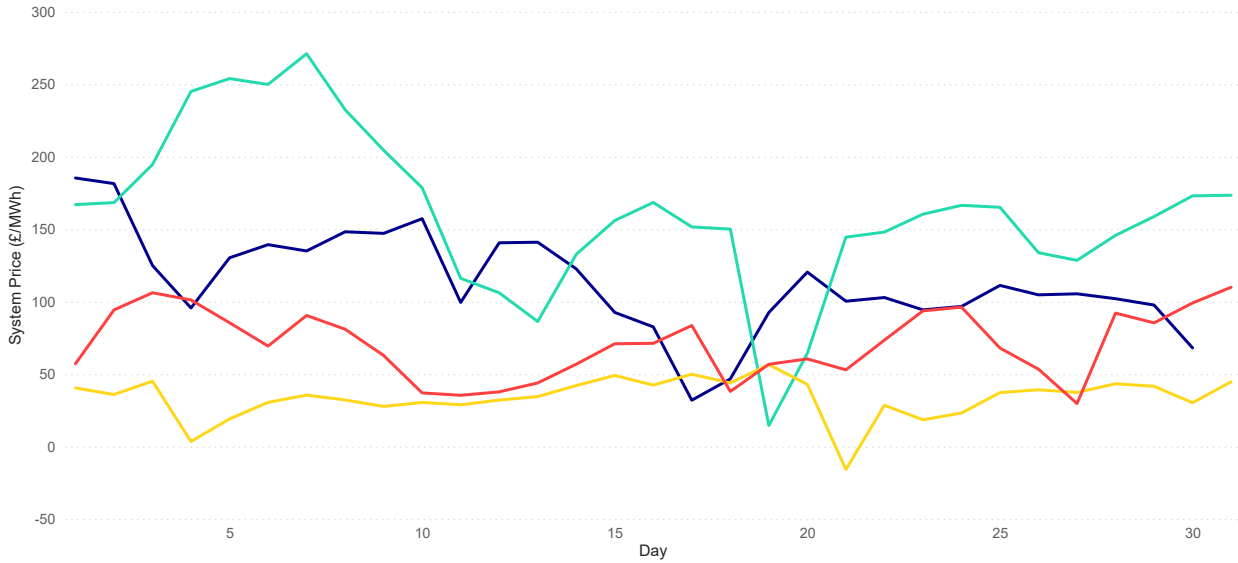

Microsoft Power BI




Daily average long System Prices were £36.86/MWh higher in May 2022 than the same month in 2021.

Average Daily System Price when Short by Settlement Day

This graph looks at System Prices from the same months as the previous graph, but when the System was short.

1.10 Average Daily System Price when Short by Settlement Day

Month ● Apr 22 ● Mar 22 ● May 21 ● May 22

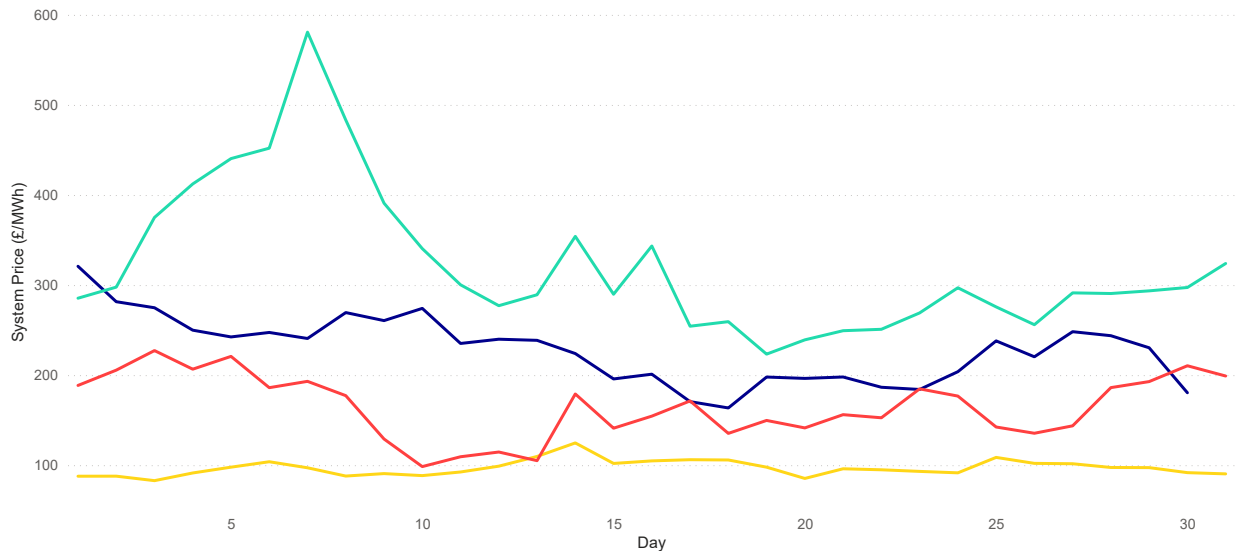


Microsoft Power BI



Short daily average System Prices were £67.96/MWh higher in May 2022 than the same month last year.

Accepted Volumes Accepted Offer Volume by Fuel Type

This graph displays the Offer volumes of fuel types that participated in the Balancing Mechanism during May 2022. Offers are balancing actions taken to increase the level of energy on the System. This report also contains balancing volumes from Balancing Services Adjustment Actions (BSAAs). BSAAs include, but are not limited to, balancing actions such as system-to-system services, Short Term Operating Reserve actions taken outside the Balancing mechanism and forward contracted energy products.

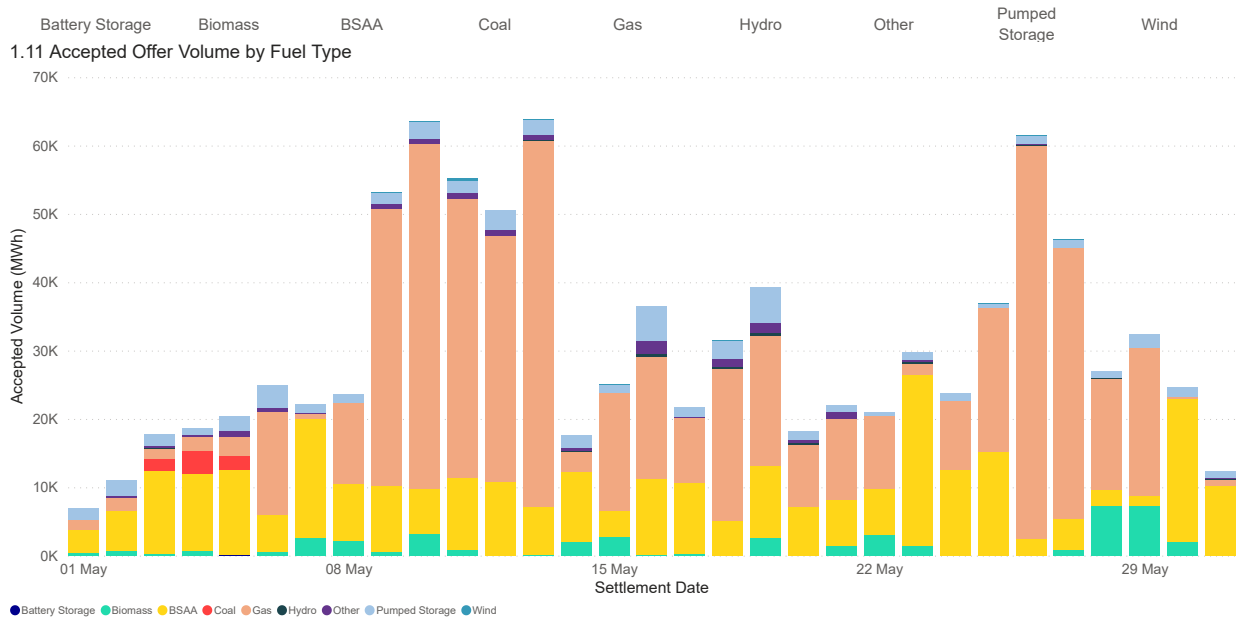


Microsoft Power BI



Accepted Bid Volume by Fuel Type

This graph displays the Bid volumes of fuel types that participated in the Balancing Mechanism during May 2022. Bids are balancing actions taken to decrease the level of energy on the System.

COOKIES SETTINGS

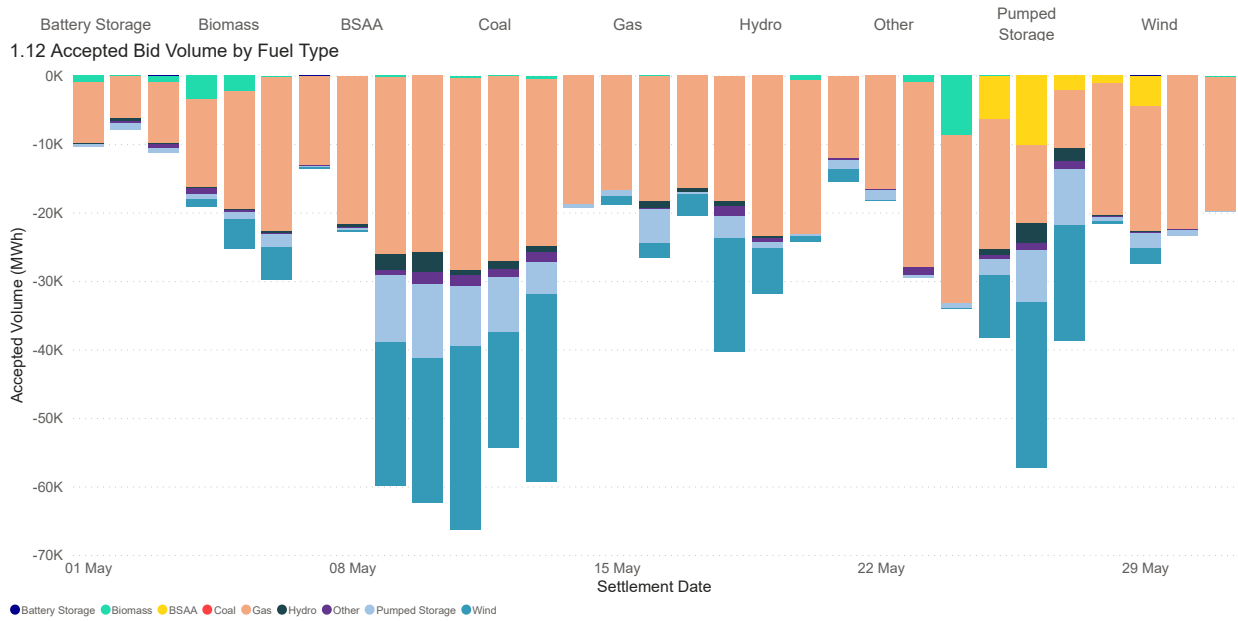

Microsoft Power BI



During May, 57% of Offer volume came from Gas BMUs with a further 30% from BSAA and 6% from Pumped Storage BMUs.

61% of Bid volume came from Gas BMUs with a further 22% from Wind and 9% from Pumped Storage BMUs.

Coal and Battery Storage BMUs contributed the least monthly total of balancing action volume for their Fuel Types in 2022. This is likely due to lower demand for electricity in May.

2 Parameters

In this section, we consider a number of different parameters on the price. We consider:

- ▶ The impact of Flagging balancing actions;
- ▶ The impact of the Replacement Price;
- ▶ The impact of NIV Tagging;

COOKIES SETTINGS

- ▶ The impact of PAR Tagging;
- ▶ The impact of DMAT and Arbitrage Tagging; and
- ▶ How these mechanisms affect which balancing actions feed into the price.

Flagging

The Imbalance Price calculation aims to distinguish between ‘energy’ and ‘system’ balancing actions. Energy balancing actions are those related to the overall energy imbalance on the system (the ‘Net Imbalance Volume’). It is these ‘energy’ balancing actions which the Imbalance Price should reflect. System balancing actions relate to non-energy, system management actions (e.g. locational constraints).


Some actions are ‘Flagged’. This means that they have been identified as potentially being ‘system related’, but rather than removing them completely from the price calculation (i.e. Tagging them) they may be re-priced, depending on their position in relation to the rest of the stack (a process called Classification). The System Operator (SO) flags actions when they are taken to resolve a locational constraint on the transmission network (SO-Flagging), or to correct short-term increases or decreases in generation/demand (Continuous Acceptance Duration Limit (CADL) Flagging).

Daily volume of SO-Flagged/non-Flagged actions


This graph shows the volumes of Buy and Sell actions in May 2022 that have been Flagged by the SO as being constraint related. On 13 May, 96% of Sell volume was SO-Flagged.

2.1 Daily volume of SO Flagged/non SO Flagged actions

Type ● Non SO Flagged Buy ● Non SO Flagged Sell ● SO Flagged Buy ● SO Flagged Sell

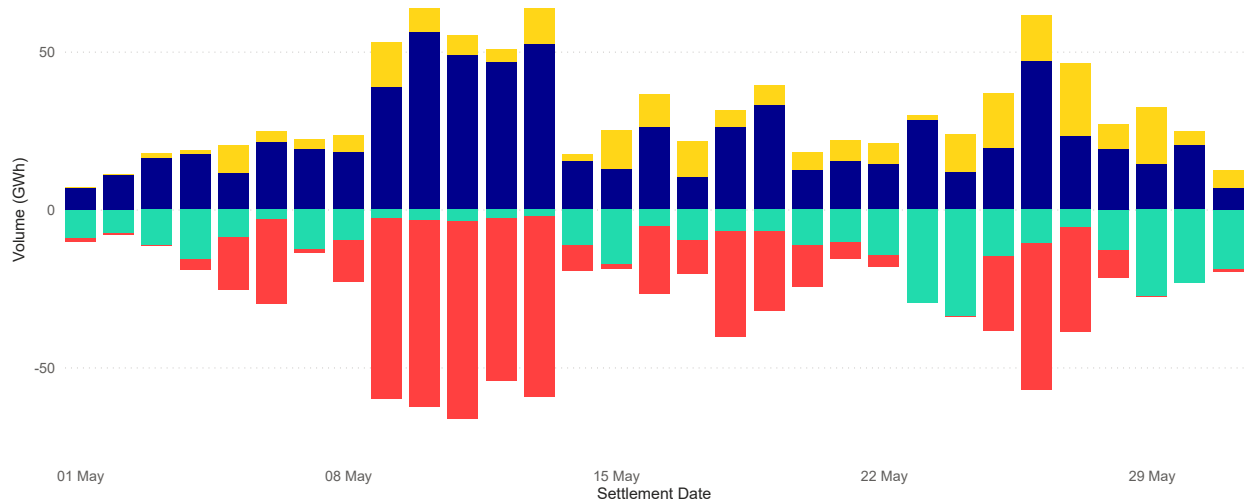

Microsoft Power BI



62% of Sell balancing action volume taken in May had an SO-Flag, compared with 33% the previous month. 46% of SO-Flagged Sell actions came from CCGT BMUs, 5% came from Balancing Service Adjustment Actions (BSAAs) and 34% from Wind BMUs. The average initial price (i.e. before any re-pricing) of a SO-Flagged Sell action was -£41.55/MWh.

24% of Buy balancing action volume taken in May had an SO-Flag, compared to 29% in April. 39% of SO-Flagged Buy actions came from CCGT BMUs and 47% from BSAAs. The average initial price of a SO-Flagged Buy action was £186.42/MWh.

Any actions with a total duration of less than the CADL are flagged. The CADL is currently set at 10 minutes.

0.8% of Buy action volume and 0.5% of Sell action volume were CADL Flagged in May. The majority of CADL Flagged Buy actions (99%), and CADL Flagged Sell actions (86%) came from Pumped Storage BMUs, with CCGT BMUs accounting for a further 13% of CADL Flagged Sell Actions.

SO-Flagged and CADL Flagged actions are known as 'First-Stage Flagged'. First-Stage Flagged come 'Second-Stage Flagged' depending on their price in relation to other

Unflagged actions. If a First-Stage Flagged balancing action has a more expensive price than the most expensive First-Stage Unflagged balancing action, it becomes Second-Stage Flagged. This means it is considered a system balancing action and becomes unpriced.


Flagged Balancing Volumes

This graph shows First and Second-Stage Flagged action volumes as a proportion of all actions taken on the system. Note these are all the accepted balancing actions – only a proportion of these will feed through to the final price calculation.

In May, 37% of balancing volume received a First-Stage Flag with 70% of this volume going on to receive a Second-Stage Flag. On the 27 May, 67% of balancing volume was flagged; with 39% of this volume receiving a Second Stage Flag.

2.2 Flagged volume percentage

Flag ● Stage 1 ● Stage 2 ● Unflagged

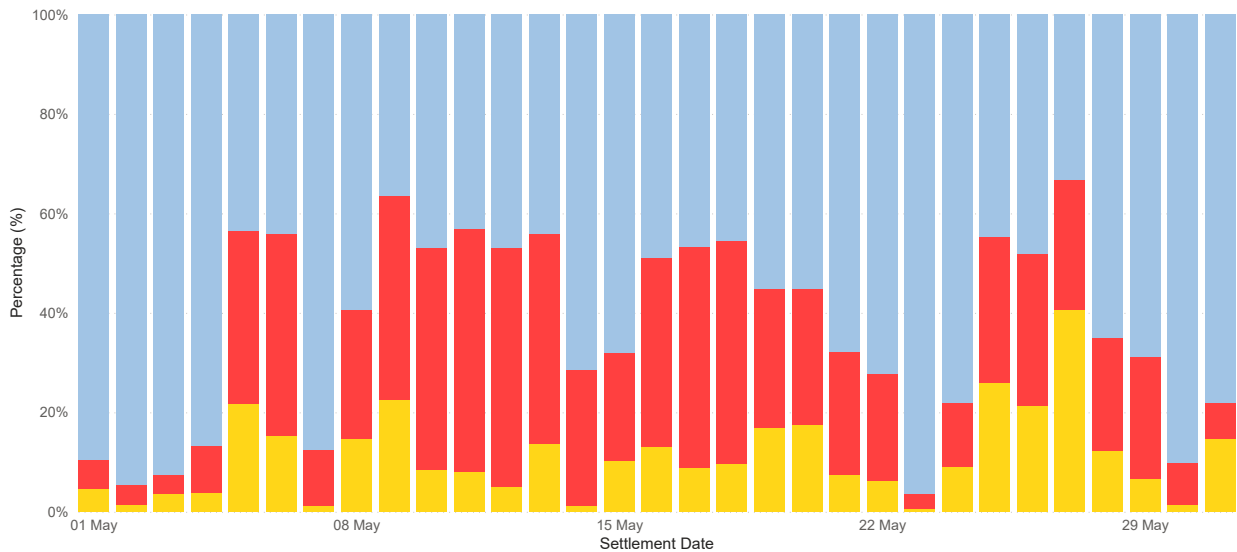

Microsoft Power BI




The Replacement Price

Any Second-Stage Flagged action volumes left in the NIV will be repriced using the Replacement Price. The Replacement Price is either based on the Replacement Price Average Reference (RPAR currently based on the most expensive 1MWh of Unflagged actions), or if no Unflagged actions

COOKIES SETTINGS

remain after NIV Tagging, the Market Index Price (MIP). In May, 236 (16%) Settlement Periods had a Replacement Price based on the RPAR and 65 (4%) Settlement Periods had a Replacement Price based on the MIP. However, the majority of Settlement Periods (80%) did not have a Replacement Price.

Number of Settlement Periods with Replacement Price by System Length displays the count of Settlement Periods which had a Replacement Price applied, split by the system length and if the Replacement Price was based on RPAR or the MIP.

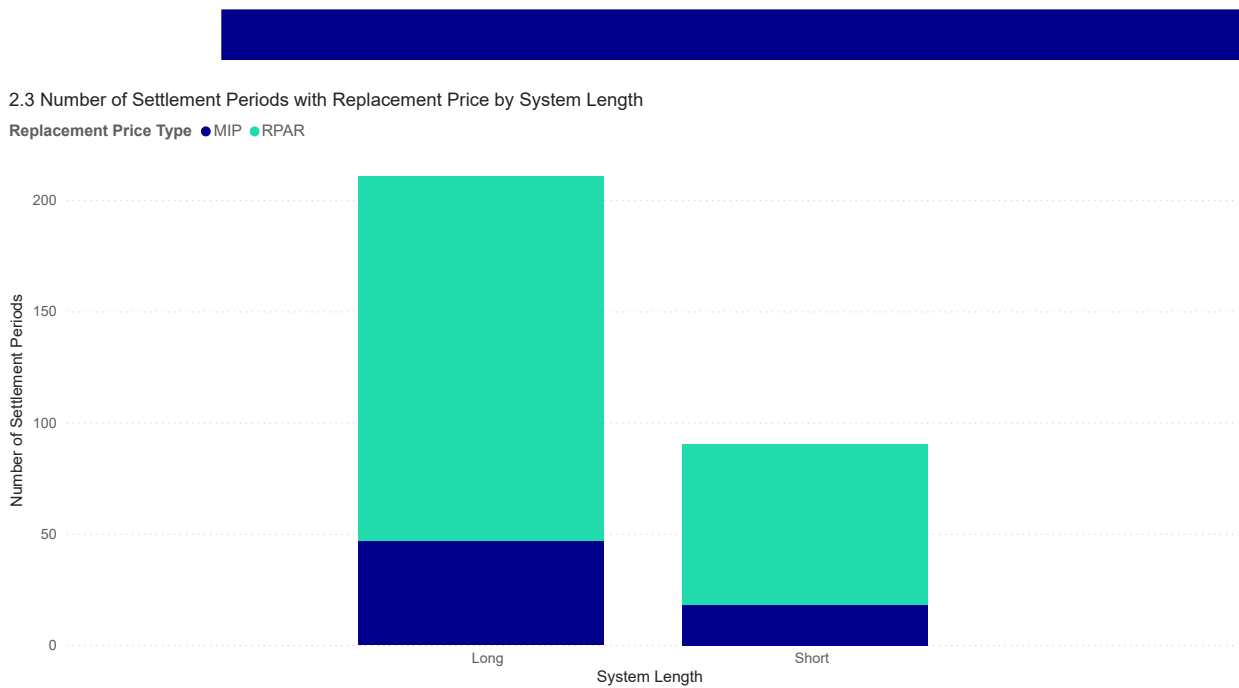

Microsoft Power BI



Average Price and Replacement Price by System Length

This table displays the average original and Replacement Price of Second-Stage Flagged actions

System Length

Long

Replacement Price	70.14
--------------------------	-------

Short

Original Price	224.63
-----------------------	--------

Replacement Price	160.66
--------------------------	--------

Source: Elexon

Sell actions will typically have their prices revised upwards by the Replacement Price for the purposes of calculating the System Price. In total, 62% of Sell volume in May was Flagged. Of this Flagged Sell volume, 14% was assigned a Replacement Price. The average original price of a Second-Stage Flagged repriced Sell action was -£13.79/MWh and the average Replacement Price for Sell actions (when the System was long) was £70.14/MWh.


25% of Buy volume were Flagged; 5.9% of this volume had the Replacement Price applied. The average original price of a Second-Stage Flagged repriced Buy action was £224.63/MWh and the average Replacement Price for Buy actions (when the System was long) was £160.66/MWh.

If there are no Unflagged actions remaining in the NIV, the Replacement Price will default to the MIP. This occurred in 47 long and 18 short Settlement Periods in May, compared to 14 long and 7 short Settlement Periods the previous month.

Monthly Average Long Price, Short Price and MIP

This graph compares the monthly average MIP to the monthly average long and short System Prices for the past 13 months. The monthly average long price decreased by -£40.67/MWh to £70.25/MWh, the short price decreased by -£64.26/MWh to £166.27/MWh and the MIP decreased by -£52.52/MWh to £120.20/MWh in May 2022 compared to the previous month.

2.5 Monthly Average Long Price, Short Price and MIP

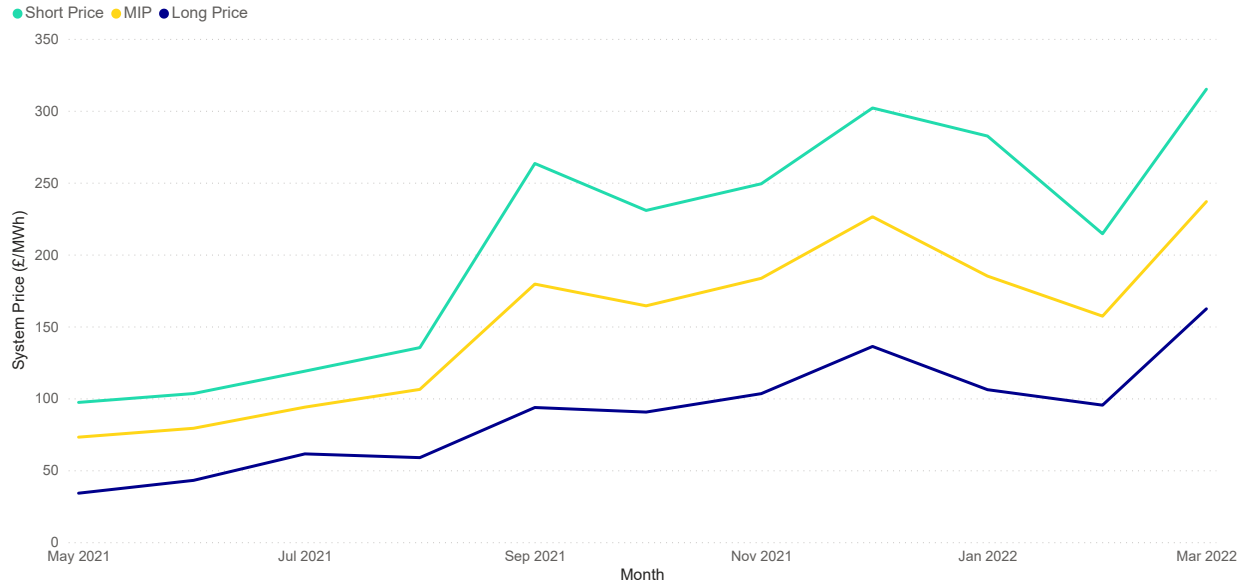

Microsoft Power BI



NIV and NIV Tagging


The Net Imbalance Volume (NIV) represents the direction of imbalance of the system – i.e. whether the system is long or short overall.

Short system NIV

This graph shows the greatest and average NIV when the system was short.

2.6 Short System NIV

● Average of NIV ● Max of NIV

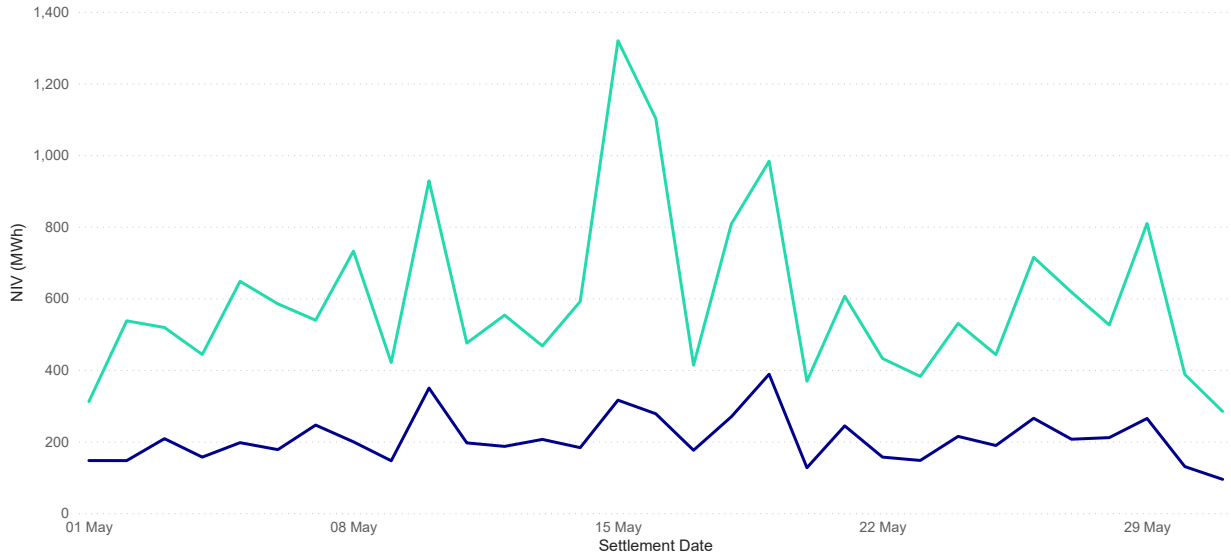

Microsoft Power BI




Long system NIV

This graph shows the minimum and average NIVs when the system was long. Note short NIVs are depicted as positive volumes and long NIVs are depicted as negative volumes.

2.7 Long System NIV

● Average of NIV ● Min of NIV

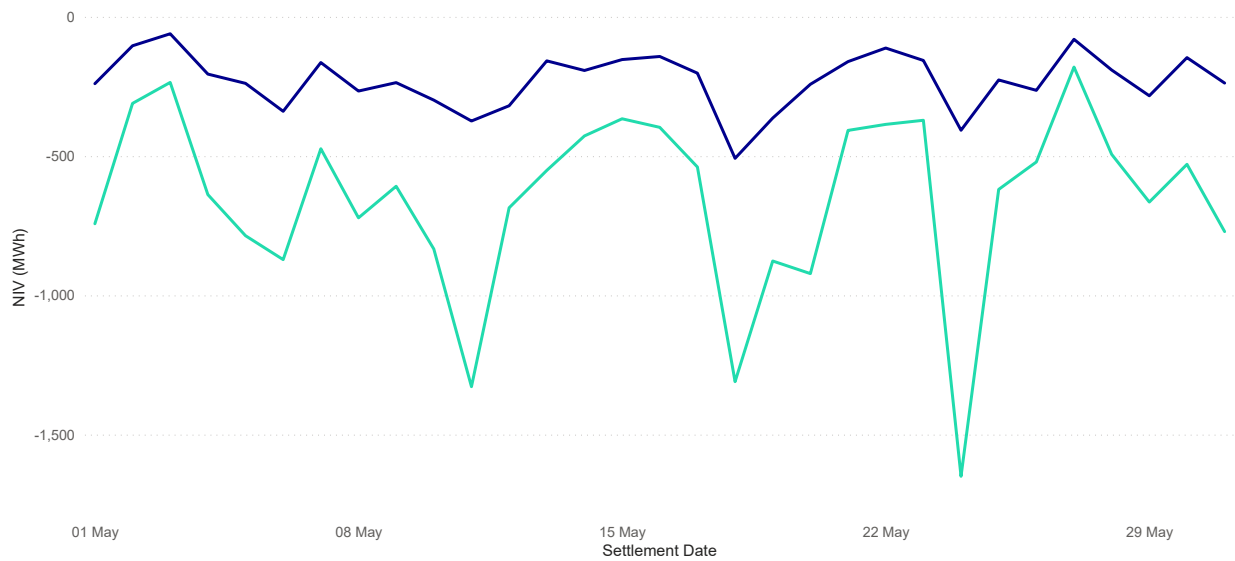

Microsoft Power BI



In almost all Settlement Periods, the System Operator will need to take balancing actions in both directions (Buys and Sells) to balance the system. However, for the purposes of calculating an Imbalance Price there can only be imbalance in one direction (the Net Imbalance). 'NIV Tagging' is the process which subtracts the smaller stack of balancing actions from the larger one to determine the Net Imbalance. The price is then derived from these remaining actions.

NIV Tagging has a significant impact in determining which actions feed through to prices. In May, 82% of volume was removed due to NIV tagging. The most expensive actions are NIV Tagged first; hence NIV Tagging has a dampening effect on prices when there are balancing actions in both directions.

The maximum short system NIV of the month (1,320MWh) was seen in Settlement Period 35 on 15 May, where the System Price was £194.00/MWh.

The minimum long system NIV of the month was -1,649MWh, in Settlement Period 30 on 24 May, where the System Price was £80.05/MWh.


Net Imbalance Volume and System Price

[COOKIES SETTINGS](#)

This graph displays a scatter graph of Net Imbalance Volume and System Prices. The dashed lines display a 0MWh NIV and a £0.00/MWh System Price, the red line is a trendline with the expected System Price from a particular NIV based on the month's data.

2.8 Net Imbalance Volume and System Price

System Length ● Long ● Short

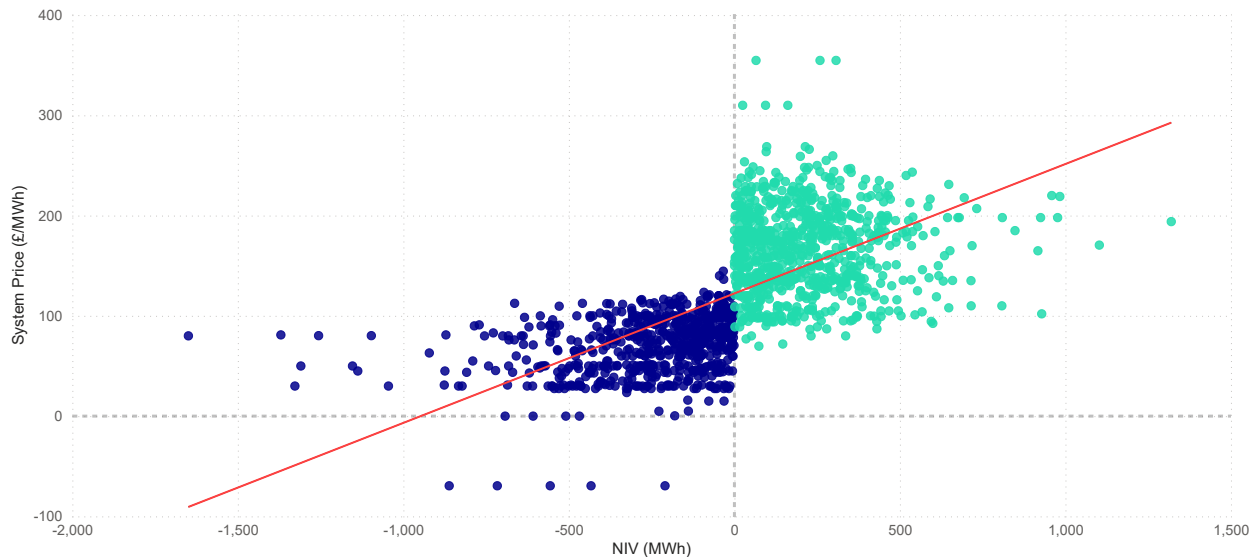

Microsoft Power BI



There were 665 long Settlement Periods in May 36 of which occurred on 11 May. The average NIV on this day was -231MWh, with the lowest NIV (-1,3285MWh) occurring in Settlement Period 31 when the System Price was £30.00/MWh. 11 May had a daily average System Price in long Settlement Periods of £35.48/MWh the second lowest daily average System Price in long Settlement Periods of the month.

PAR Tagging

PAR Tagging is the final step of the Imbalance Price calculation. It takes a volume-weighted average of the most expensive 1MWh of actions left in the stack. The value of PAR is set at 1MWh.

PAR Tagging is active in almost all Settlement Periods, the only periods not affected by the parameter have a NIV of less than 1MWh.


COOKIES SETTINGS

During May, there were 4 Settlement Periods where PAR Tagging was inactive. The average NIV in these Settlement Periods was 0.14MWh. Settlement Period 9 on 4 May had the lowest absolute NIV (0.04MWh), and therefore was the most balanced Settlement Period of the month.

DMAT and Arbitrage Tagged Volumes

Some actions are always removed from the price calculation (before NIV Tagging). These are actions which are less than the De Minimis Acceptance Threshold (DMAT) Tagging or Buy actions which are either the same price or lower than the price of Sell actions (Arbitrage Tagging). The DMAT is set at 0.1MWh.

Daily Volume of DMAT Tagged volume This graph shows the volumes of actions removed due to DMAT Tagging.

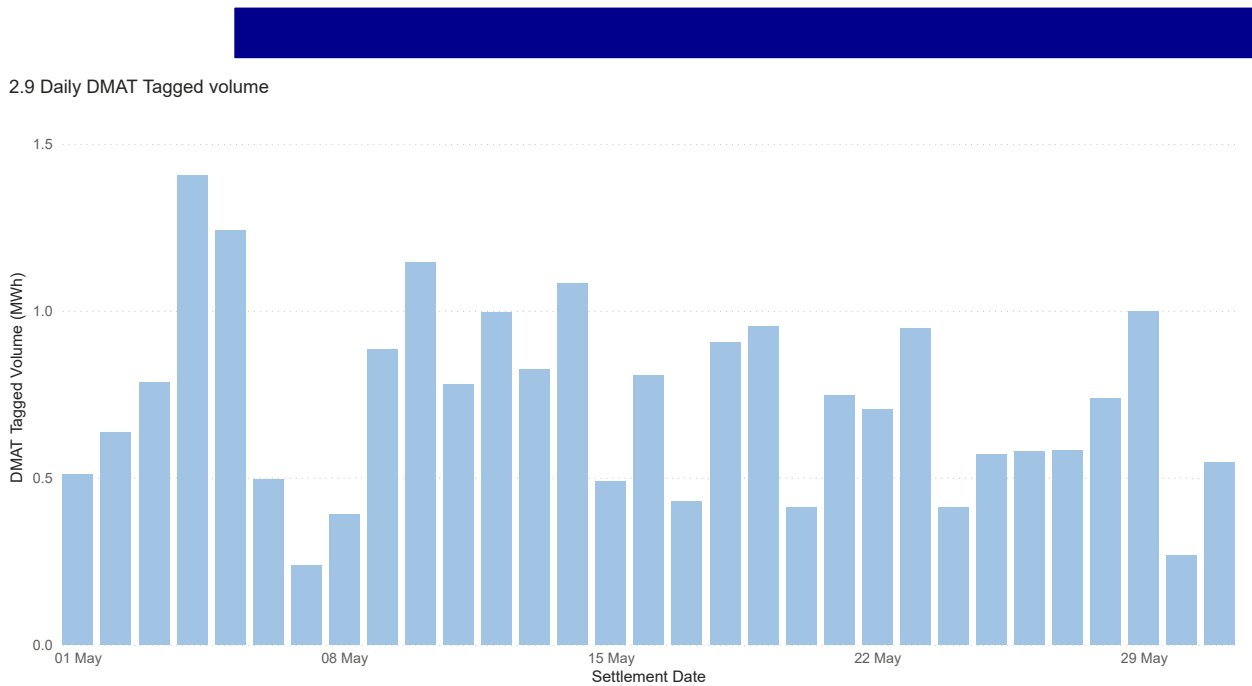

Microsoft Power BI




22.5MWh of total Buy and Sell volume was removed by DMAT Tagging in May, compared to 22.2MWh the previous month. 60% of the DMAT Tagged volume came from CCGT BMUs, 19% from other BMUs and 8% from Wind BMUs.

Daily volume of Arbitrage Tagged volume

This graph shows the volumes of actions that were removed due to Arbitrage Tagging.

COOKIES SETTINGS

2.10 Daily Arbitrage Tagged volume

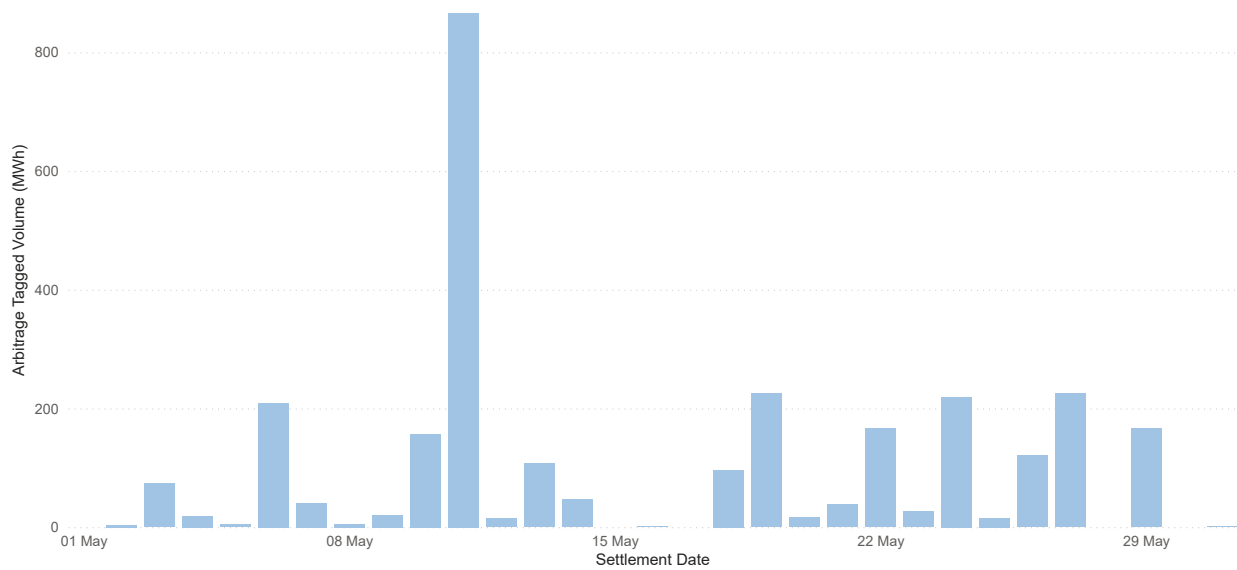

Microsoft Power BI



2887MWh of total Buy and Sell volume was removed by Arbitrage Tagging in May. 59% of the Arbitrage Tagged came from CCGT BMUs, 23% from Wind BMUs and 6% from BSAAs.

In May, the average initial price of an Arbitrage Tagged Buy action was £89.77/MWh, and for a Sell action was £95.53/MWh. The maximum initial price of an Arbitrage Tagged Sell action was £220.00/MWh, and the lowest priced Arbitrage Tagged Buy action was -£75.67/MWh.

On 11 May, 866MWh of actions were Arbitrage Tagged, representing 0.7% of the daily volume of balancing actions. The average price of an Arbitrage Tagged Buy action was -£12.18/MWh, and for a Sell action was £45.88/MWh on this day. 51% of the Arbitrage Tagged Volume came from CCGT BMUs and 49% from Wind BMUs.

3 Balancing Services

Short Term Operating Reserve (STOR) costs and volumes


This section covers the balancing services that the System Operator (SO) takes outside the Balancing Mechanism that can affect the price.

In addition to Bids and Offers available in the Balancing Mechanism, the SO can enter into contracts with providers of balancing capacity to deliver when called upon. These additional sources of power are referred to as reserve, and most of the reserve that the SO procures is called Short Term Operating Reserve (STOR).


Under STOR contracts, availability payments are made to the balancing service provider in return for capacity being made available to the SO during specific times (STOR Availability Windows). When STOR is called upon, the SO pays for it at a pre-agreed price (its Utilisation Price). Some STOR is dispatched in the Balancing Mechanism (BM STOR) while some is dispatched separately (Non-BM STOR).

Daily STOR vs Non-BM STOR volume

This graph gives STOR volumes that were called upon during the month split into BM STOR and non-BM STOR. All STOR volume utilised in May came from inside of the Balancing Mechanism (BM STOR).

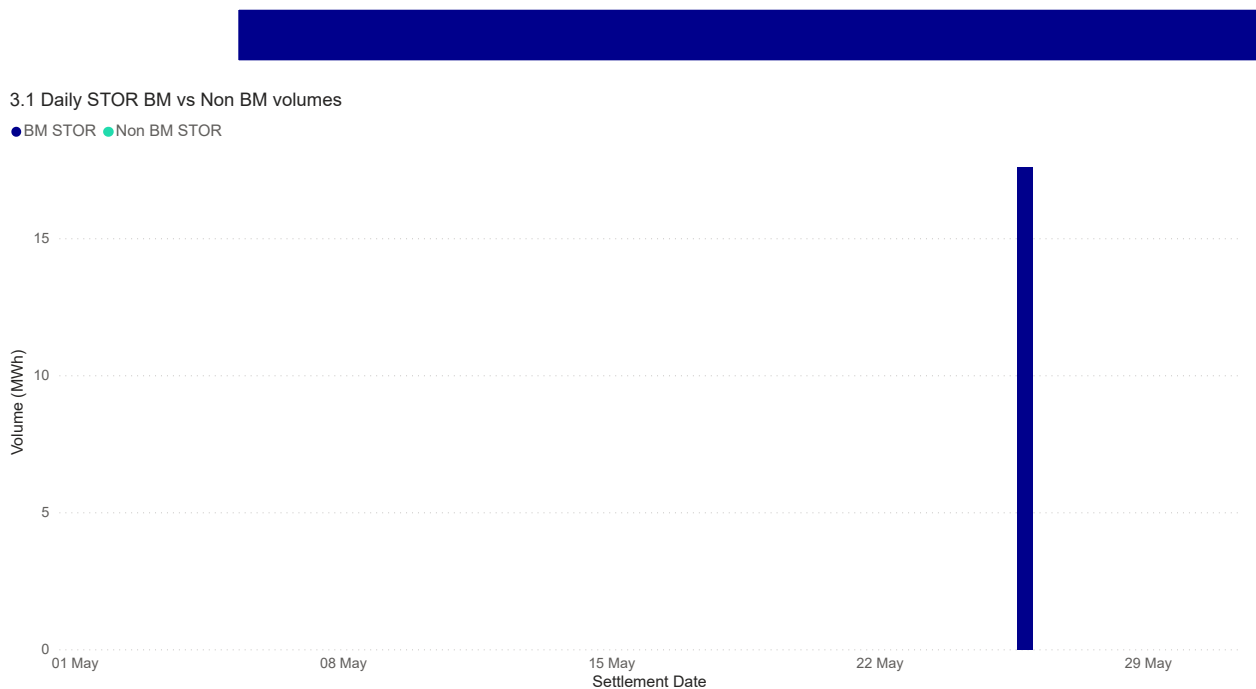

Microsoft Power BI



Daily STOR vs Non-BM STOR utilisation costs

COOKIES SETTINGS

This graph shows the utilisation costs of this capacity. The average Utilisation Price for BM STOR capacity in May was £201.90/MWh.



Microsoft Power BI



The 26 May was the only day where the National Electricity Transmission System Operator (NETSO) called upon STOR. All STOR volume was from inside the BM an cost £3,553 for 17.6MWh of power. This is the lowest amount of STOR utilisation since August 2020 where no STOR was used for the entire month.

De-Rated Margin, Loss of Load Probability and the Reserve Scarcity Price


There are times when the Utilisation Prices of STOR plants are uplifted using the **Reserve Scarcity Price (RSVP)** in order to calculate System Prices. The RSVP is designed to respond to capacity margins, so rises as the system gets tighter (the gap between available and required generation narrows). It is a function of **De-Rated Margin (DRM)** at Gate Closure, the likelihood that this will be insufficient to meet demand (the **Loss of Load Probability, LoLP**) and the **Value of Lost Load (VoLL, set at £6,000/MWh from 1 November 2018)**.

Minimum and average DRMs This graph shows the daily minimum and average Gate Closure DRMs for May 2022.

COOKIES SETTINGS

3.3 Minimum and average DRMs

● Average of DRM ● Min of DRM

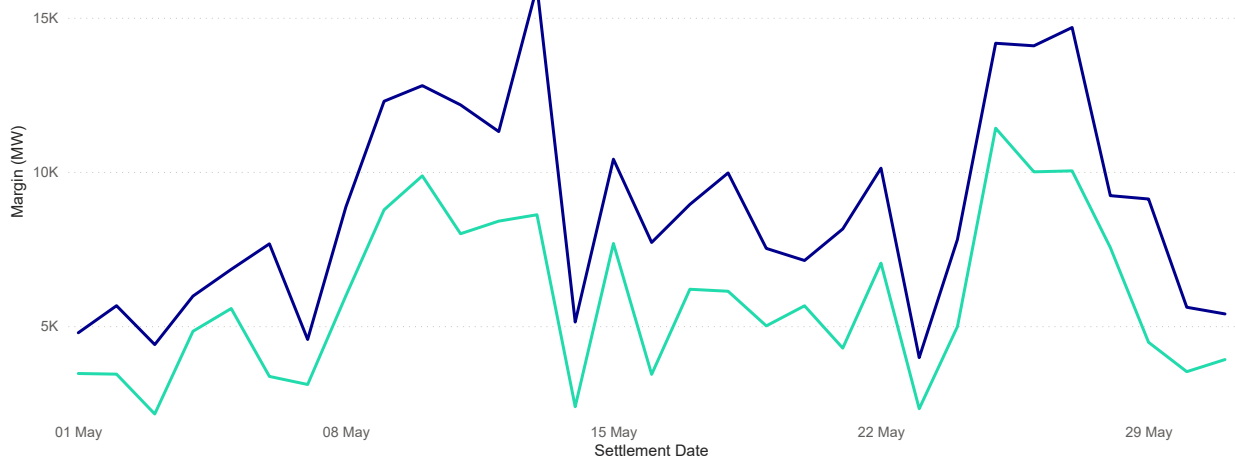

Microsoft Power BI



The System Operator has determined a dynamic relationship between each DRM and the LoLP, which will determine the RSVP.

The minimum DRM in May was 2.15GW on 3 May in Settlement Period 39 (compared to 2.657GW in April). This DRM corresponded to a LoLP of 0.0016 and an RSVP of £9.34/MWh (see **Top 5 LoLPs and RSVPs**).

The RSVP re-prices STOR actions in the Imbalance Price calculation if it is higher than the original Utilisation Price. No actions were repriced with the RSVP during May.

Top 5 LoLPs and RSVPs

Settlement Date

27/04/2022

Settlement Period

39

COOKIES SETTINGS

DRM (MW)	2,150
-----------------	-------

LoLP	0.0016
-------------	--------

RSVP (£/MWh)	9.34
---------------------	------

RSVP Used	No
------------------	----

System Price (£/MWh)	354.75
-----------------------------	--------

System Length	Short
----------------------	-------

27/04/2022

Settlement Period	25
--------------------------	----

DRM (MW)	2,321
-----------------	-------

LoLP	0.0005
-------------	--------

RSVP (£/MWh)	3.06
---------------------	------

RSVP Used	No
------------------	----

System Price (£/MWh)	178.50
-----------------------------	--------

System Length	Short
----------------------	-------

28/04/2022

Settlement Period	41
--------------------------	----

DRM (MW)	2,387
-----------------	-------

LoLP	0.0022
-------------	--------

[COOKIES SETTINGS](#)

RSVP (£/MWh)	13.02
---------------------	-------

RSVP Used	No
------------------	----

System Price (£/MWh)	218.98
-----------------------------	--------

System Length	Short
----------------------	-------

28/04/2022

Settlement Period	40
--------------------------	----

DRM (MW)	2,428
-----------------	-------

LoLP	0.0005
-------------	--------

RSVP (£/MWh)	2.77
---------------------	------

RSVP Used	No
------------------	----

System Price (£/MWh)	244.74
-----------------------------	--------

System Length	Short
----------------------	-------

27/04/2022

Settlement Period	43
--------------------------	----

DRM (MW)	2,536
-----------------	-------

LoLP	0.0003
-------------	--------

RSVP (£/MWh)	2.10
---------------------	------

RSVP Used	No
------------------	----

[COOKIES SETTINGS](#)

System Price (£/MWh) 221.93

System Length Short

Source: Elexon

Contact information

Analysis and Insight Team
Analysis.Insight@elexon.co.uk

PDF versions

Download PDFs of previous reports from the [SPAR archive](https://www.elexon.co.uk/about/key-data-reports/system-prices-analysis-report/spar-archive/)
(<https://www.elexon.co.uk/about/key-data-reports/system-prices-analysis-report/spar-archive/>)

BSC Insights

- [The electricity market](https://www.elexon.co.uk/about/elexon-insights/bsc-insights-the-electricity-market/) >
(<https://www.elexon.co.uk/about/elexon-insights/bsc-insights-the-electricity-market/>)
- [Code Governance and reforms](https://www.elexon.co.uk/about/elexon-insights/bsc-insights-code-governance-and-reforms/) >
(<https://www.elexon.co.uk/about/elexon-insights/bsc-insights-code-governance-and-reforms/>)
- [Imbalance and Settlement](https://www.elexon.co.uk/about/elexon-insights/bsc-insights-imbalance-and-settlement/) >
(<https://www.elexon.co.uk/about/elexon-insights/bsc-insights-imbalance-and-settlement/>)
- [System Prices](https://www.elexon.co.uk/about/elexon-insights/bsc-insights-system-prices/) >
(<https://www.elexon.co.uk/about/elexon-insights/bsc-insights-system-prices/>)
- [Supporting changes in the energy system](https://www.elexon.co.uk/about/elexon-insights/bsc-insights-supporting-changes-in-the-energy-system/) >
(<https://www.elexon.co.uk/about/elexon-insights/bsc-insights-supporting-changes-in-the-energy-system/>)
- [Managing the BSC](https://www.elexon.co.uk/about/elexon-insights/bsc-insights-managing-the-bsc/) >
(<https://www.elexon.co.uk/about/elexon-insights/bsc-insights-managing-the-bsc/>)

COOKIES SETTINGS

Accessibility

Please let us know if you cannot access this information or need it in an alternative format.

communications@elexon.co.uk